

NFPA[®]

253

Standard Method of Test for
Critical Radiant Flux of Floor
Covering Systems Using a Radiant
Heat Energy Source

2023



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.



REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2022 National Fire Protection Association®. All Rights Reserved.

NFPA® 253

Standard Method of

Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source

2023 Edition

This edition of NFPA 253, *Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source*, was prepared by the Technical Committee on Fire Tests. It was issued by the Standards Council on April 28, 2022, with an effective date of May 18, 2022, and supersedes all previous editions.

This edition of NFPA 253 was approved as an American National Standard on May 18, 2022.

Origin and Development of NFPA 253

Experience suggests that during the early stages of a fire, floor covering systems seldom act as a fire-spread medium. However, in a few fires involving multiple-occupancy buildings, the floor covering materials in corridors were primarily responsible for fire spread over a considerable distance. Those situations caused grave concern and pointed to the need for a realistic test to evaluate the flame spread of floor covering systems.

The inception of the flooring radiant panel test was at the Armstrong Cork Company in 1966. In 1972, conceptualization of critical radiant flux (W/cm^2 at extinguishment) as a measure of flame spread hazard was underway at the National Bureau of Standards (NBS). It was determined in the course of NBS work on model corridor fire tests that the radiant energy levels incident on the floor covering had a considerable influence on whether or not flaming combustion would propagate. Accordingly, it was natural to apply the critical radiant flux concept, and, in 1973, the NBS prepared a draft of the flooring radiant panel test.

In 1975, the Technical Committee on Fire Tests began its evaluation of the proposed test methods, which culminated in the adoption of the test as an official NFPA standard in May 1978. The standard was revised in 1984 and 1990.

The 1995 edition included significant improvements based on work conducted by the National Institute of Standards and Technology (NIST) and the carpet industry. Those findings improved the overall application of the standard and provided measured improvement in test precision. Other changes included a new pilot burner and reduction of the variation in the airflow through the chamber, which reduced the variability of data. Revisions also were made to eliminate “permissive” language. The revisions created closer harmony with ASTM E648, *Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source*.

The 2000 edition was a reconfirmation of the 1995 edition.

The 2006 edition included a complete editorial rewrite for compliance with the *Manual of Style for NFPA Technical Committee Documents*. Further organizational and editorial changes were made to clarify the requirements of the test method. Provisions regarding safety precautions were moved to the annexes, and additional details were provided on simulating a concrete floor during the test.

The 2011 edition was revised to create uniformity with other fire test standards. Provisions for laminate floor mounting were added to Chapter 5.

In 2015, revisions were made to provide clarity on airflow rates and updated examples of test apparatuses.

The 2019 edition was revised to reference the latest test methods and to address modern materials used for simulated concrete flooring.

The 2023 edition includes terminology clarification and moves the radiation instrumentation calibration information from Annex B to a mandatory section in Chapter 6.



Technical Committee on Fire Tests

Barry L. Badders, Jr., Chair
Intertek Testing Services, TX [RT]

Hubert Biteau, S-E-A, Ltd., CO [SE]
Benjamin H. Caldwell, Skidmore, Owings & Merrill LLP (SOM), NY [SE]
Karen C. Carpenter, Southwest Research Institute, TX [RT]
Rick D. Davis, National Institute of Standards & Technology (NIST), MD [RT]
Scott E. Dillon, Crane Engineering, MN [SE]
William E. Fitch, Phyrefish.com, FL [SE]
Richard G. Gann, Gaithersburg, MD [SE]
Marcelo M. Hirschler, GBH International, CA [SE]
Paul A. Hough, Armstrong World Industries, Inc., PA [M]
William E. Koffel, Koffel Associates, Inc., MD [SE]
Sergei V. Levchik, Israel Chemicals Ltd. (ICL-IP), NY [M]
Rep. ACC-North American Flame Retardant Alliance
Michael E. Luna, ICC NTA, LLC, TX [RT]
James Andrew Lynch, The Fire Solutions Group, PA [SE]
John Martell, Professional Fire Fighters of Maine/IAFF, ME [L]
Rep. International Association of Fire Fighters

Rodney A. McPhee, Canadian Wood Council, Canada [M]
Kathleen A. Newman, Firetect, CA [M]
Nicholas Ozog, Wiss, Janney, Elstner Associates, Inc., IL [SE]
Arthur J. Parker, JENSEN HUGHES, MD [SE]
Bill Perdue, American Home Furnishings Alliance (AHFA), NC [U]
Shamim Rashid-Sumar, National Ready Mixed Concrete Assn., NY [M]
Michael L. Savage, Sr., Marion County Building Safety, FL [E]
Michael Schmeida, Gypsum Association, OH [M]
David T. Sheppard, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
Dwayne Sloan, UL LLC, NC [RT]
Kuma Sumathipala, American Wood Council, VA [M]
Robert J. Wills, American Iron and Steel Institute, AL [M]
Dong Zeng, FM Global, MA [I]
Rep. FM Global

Alternates

Marc Alam, Canadian Wood Council, Canada [M]
(Alt. to Rodney A. McPhee)
Richard J. Davis, FM Global, MA [I]
(Alt. to Dong Zeng)
Timothy Earl, GBH International, MI [SE]
(Alt. to Marcelo M. Hirschler)
Stephen Paul Fuss, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
(Alt. to David T. Sheppard)
Justin A. Geiman, Fire and Risk Alliance LLC, MD [SE]
(Alt. to James Andrew Lynch)
Karl Dana Houser, Intertek, PA [RT]
(Alt. to Barry L. Badders, Jr.)
Jonathan Humble, American Iron and Steel Institute, CT [M]
(Alt. to Robert J. Wills)

Marc L. Janssens, Southwest Research Institute, TX [RT]
(Alt. to Karen C. Carpenter)
Elizabeth C. Keller, Engineering Systems, Inc., NC [SE]
(Alt. to Scott E. Dillon)
Cori Leffler, Firetect, CA [M]
(Alt. to Kathleen A. Newman)
Daniel A. Martin, JENSEN HUGHES, MD [SE]
(Alt. to Arthur J. Parker)
Jason V. Smart, American Wood Council (AWC), VA [M]
(Alt. to Kuma Sumathipala)
Matthew T. Vinci, International Association of Fire Fighters, DC [L]
(Alt. to John Martell)
Luke C. Woods, UL LLC, MA [RT]
(Alt. to Dwayne Sloan)

Nonvoting

Rohit "Rik" Khanna, US Consumer Product Safety Commission (CPSC), MD [C]
Rep. US Consumer Product Safety Commission

Andrew Lock, US Consumer Product Safety Commission, MD [C]
Rep. US Consumer Product Safety Commission

Tracy L. Vecchiarelli, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA, for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members, and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 Administration	253- 5	6.2 Calibration of Radiation Instrumentation.	253- 13
1.1 Scope.	253- 5	Chapter 7 Test Procedure	253- 13
1.2 Purpose.	253- 5	7.1 Pretest Heating.	253- 13
1.3 Application.	253- 5	7.2 Sample Mounting.	253- 13
1.4 Summary of Test Method.	253- 5	7.3 Ignition of Pilot Burner.	253- 13
Chapter 2 Referenced Publications	253- 6	7.4 Flame Propagation of Specimen.	253- 13
2.1 General.	253- 6	7.5 Completion of Test.	253- 14
2.2 NFPA Publications. (Reserved)	253- 6	7.6 Data Collection and Recording.	253- 14
2.3 Other Publications.	253- 6	7.7 Removal of Specimen.	253- 14
2.4 References for Extracts in Mandatory Sections.	253- 6	7.8 Subsequent Testing.	253- 14
Chapter 3 Definitions	253- 6	7.9 Extent of Flame Travel After a Prescribed Period.	253- 14
3.1 General.	253- 6	Chapter 8 Calculations	253- 14
3.2 NFPA Official Definitions.	253- 6	8.1 General.	253- 14
3.3 General Definitions.	253- 7	8.2 Formulas.	253- 14
Chapter 4 Test Apparatus	253- 7	Chapter 9 Report	253- 14
4.1 Radiant Panel Test Apparatus.	253- 7	9.1 Required Information.	253- 14
4.2 Test Chamber.	253- 7	Annex A Explanatory Material	253- 14
4.3 Radiant Heat Energy Source.	253- 8	Annex B Sample Data Logs	253- 15
4.4 Specimen Holder.	253- 9	Annex C Commentary on Critical Radiant Flux Test	253- 17
4.5 Pilot Burner.	253- 9	Annex D Precision and Bias	253- 19
4.6 Thermocouples.	253- 10	Annex E Safety Precautions	253- 19
4.7 Exhaust Hood.	253- 10	Annex F Informational References	253- 19
4.8 Dummy Specimen.	253- 10	Index	253- 21
4.9 Timer.	253- 10		
Chapter 5 Test Specimens	253- 10		
5.1 Sampling Procedure.	253- 10		
5.2 Specimen Size and Mounting.	253- 10		
5.3 Specimen Conditioning.	253- 12		
Chapter 6 Radiant Heat Energy Flux Profile Standardization	253- 12		
6.1 Procedure.	253- 12		

NFPA 253

Standard Method of

Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source

2023 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the "List of NFPA Codes & Standards" at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex G.

Chapter 1 Administration

1.1 Scope.

1.1.1* This fire test response standard describes a procedure for measuring critical radiant flux behavior of horizontally mounted floor covering systems exposed to a flaming ignition source in a graded, radiant heat energy environment within a test chamber.

1.1.2* This fire test response standard measures the critical radiant flux at flameout and provides a basis for estimating one aspect of fire exposure behavior for floor covering systems.

1.2 Purpose.

1.2.1* The standard was developed to simulate an important fire exposure component in fires that develops in corridors or exit enclosures of buildings and is not intended for routine use in estimating flame spread behavior of floor covering in building areas other than corridors or exit enclosures.

1.2.2 This fire test response standard is designed to provide a basis for estimating one aspect of the fire exposure behavior of a floor covering system installed in a building corridor.

1.2.3 The test environment simulates conditions that have been observed and defined in full-scale corridor experiments.

1.3 Application.

1.3.1 This standard is used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions and is not to be used to describe or appraise the fire hazard or fire risk of materials, products, or assemblies under actual fire conditions.

1.3.2 The results of the test are permitted to be used as elements of a fire hazard assessment or a fire risk assessment that takes into account all factors that are pertinent to an assessment of the fire hazard or fire risk of a particular end use.

1.3.3* This standard does not purport to address all safety problems associated with its use.

1.3.4 The user of this standard is responsible for establishing appropriate safety and health practices and determining the applicability of regulatory limitations prior to use.

1.3.5 The fundamental assumption inherent in the test is that critical radiant flux is one measure of the sensitivity to flame spread of floor covering systems located in a building corridor.

1.3.6 The test is suitable for regulatory statutes, specification acceptance, design purposes, or development and research.

1.3.7 The test is applicable to floor covering system specimens that follow or simulate accepted installation practice.

1.3.8 Tests on the individual elements of a floor system are not valid for evaluation of the flooring system.

1.4 Summary of Test Method. The basic elements of the test chamber include an air-gas-fueled radiant heat energy panel inclined at 30 degrees to and directed at a horizontally mounted floor covering system specimen.

1.4.1 The radiant panel generates a radiant energy flux distribution along the 1000 mm length of the test specimen from a nominal maximum of 1.0 W/cm² to a minimum of 0.1 W/cm².

1.4.2 The test is initiated by open-flame ignition from a pilot burner.

1.4.3 The distance burned to flameout is converted to W/cm² from the flux profile graph shown in Figure 1.4.3 and is reported as critical radiant flux W/cm².

1.4.4 The specimen can be mounted over underlayment or over a simulated concrete structural floor, bonded to a simulated structural floor, or otherwise mounted in a typical and representative way.

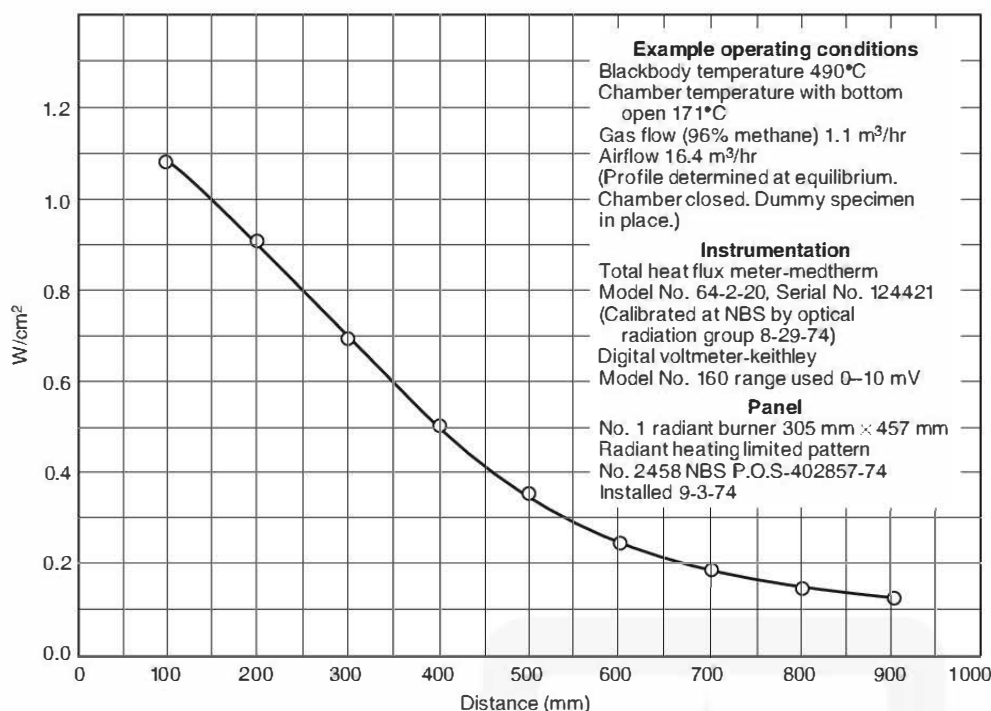


FIGURE 1.4.3 Standard Radiant Heat Energy Flux Profile.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. (Reserved)

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM C1186, *Standard Specification for Flat Fiber-Cement Sheets*, 2008 (2016).

ASTM C1288, *Standard Specification for Fiber-Cement Interior Substrate Sheets*, 2017.

ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*, 2019a.

2.3.2 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 101®, *Life Safety Code*®, 2021 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2 Shall. Indicates a mandatory requirement.

3.2.3 Should. Indicates a recommendation or that which is advised but not required.

3.2.4 Standard. An NFPA standard, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA manuals of style. When used in a generic sense, such as in the phrases "standards development process" or "standards development activities," the term "standards" includes all NFPA standards, including codes, standards, recommended practices, and guides.

3.3 General Definitions.

3.3.1 Blackbody Temperature. The temperature of a perfect radiator having a surface with an emissivity of unity and, therefore, a reflectivity of zero (0).

3.3.2 Critical Radiant Flux. The level of incident radiant heat energy in units of W/cm^2 on a floor-covering system at the most distant flameout point. [101, 2021]

3.3.3* Flameout. The time period measured from the point in time identified as time zero at which the specimen is moved into the chamber and the door is closed to the point in time at which the last vestige of flame or glow disappears from the surface of the test specimen, frequently accompanied by a final puff of smoke.

3.3.4 Floor Covering. An essentially planar material with a small thickness in comparison to its length or width, which is laid on a floor to enhance the beauty, comfort, and utility of the floor.

3.3.5 Floor Covering System. A single material, composite, or assembly composed of the floor covering and related installation components such as adhesive or cushion, if any.

3.3.6 Flooring. A primary floor surface or a final floor surface.

3.3.7 Flux Profile. The curve of incident radiant heat energy on the specimen plane relative to the distance from the point of initiation of flaming ignition (i.e., 0 mm).

3.3.8 Standard Simulated Concrete Subfloor. See 5.2.3.

3.3.9 Total Flux Meter. The instrument used to measure the level of radiant heat energy incident on the specimen plane at any point.

Chapter 4 Test Apparatus

4.1 Radiant Panel Test Apparatus. The apparatus shall be as shown in Figure 4.1(a) and Figure 4.1(b).

4.2 Test Chamber. The flooring radiant panel test chamber employed for this test shall be located in a draft-protected laboratory.

4.2.1 The flooring radiant panel test chamber shall consist of an enclosure $1400 \text{ mm} \pm 10 \text{ mm}$ long $\times 500 \text{ mm} \pm 10 \text{ mm}$ wide $\times 710 \text{ mm} \pm 10 \text{ mm}$ high above the test specimen as indicated in Figure 4.2.1(a) and Figure 4.2.1(b).

4.2.1.1 The sides, ends, and top shall be of 13 mm calcium silicate board with a nominal density insulating material of $740 \text{ kg}/\text{m}^3$ and shall have a thermal conductivity at 177°C of $0.128 \text{ W}/(\text{m}\cdot\text{K})$.

4.2.1.2 One side shall be provided with a draft-tight, fire-resistant glass window nominally $100 \text{ mm} \times 1100 \text{ mm}$ so that the entire length of the test specimen can be observed from outside the fire test chamber.

4.2.1.3 On the side specified in 4.2.1.2 and below the observation window, a door shall be there that, when open, allows the specimen platform to be moved out for mounting or removal of test specimens.



FIGURE 4.1(a) Flooring Radiant Panel Test Apparatus.



FIGURE 4.1(b) Flooring Radiant Panel Test Apparatus Showing Carpet Specimen and Gas-Fueled Panel.

4.2.1.4 Where necessary for observation, a draft-tight, fire-resistant observation window shall be installed at the low flux end of the chamber.

4.2.2 The bottom of the test chamber shall consist of a sliding steel platform that has provisions for rigidly securing the test specimen holder in a fixed and level position.

4.2.2.1 The test specimen holder shall be level when in place and shall be secured to the specimen mounting platform.

4.2.2.2 The free, or air access, area around the platform shall be in the range from $230,000 \text{ mm}^2$ to $322,500 \text{ mm}^2$.

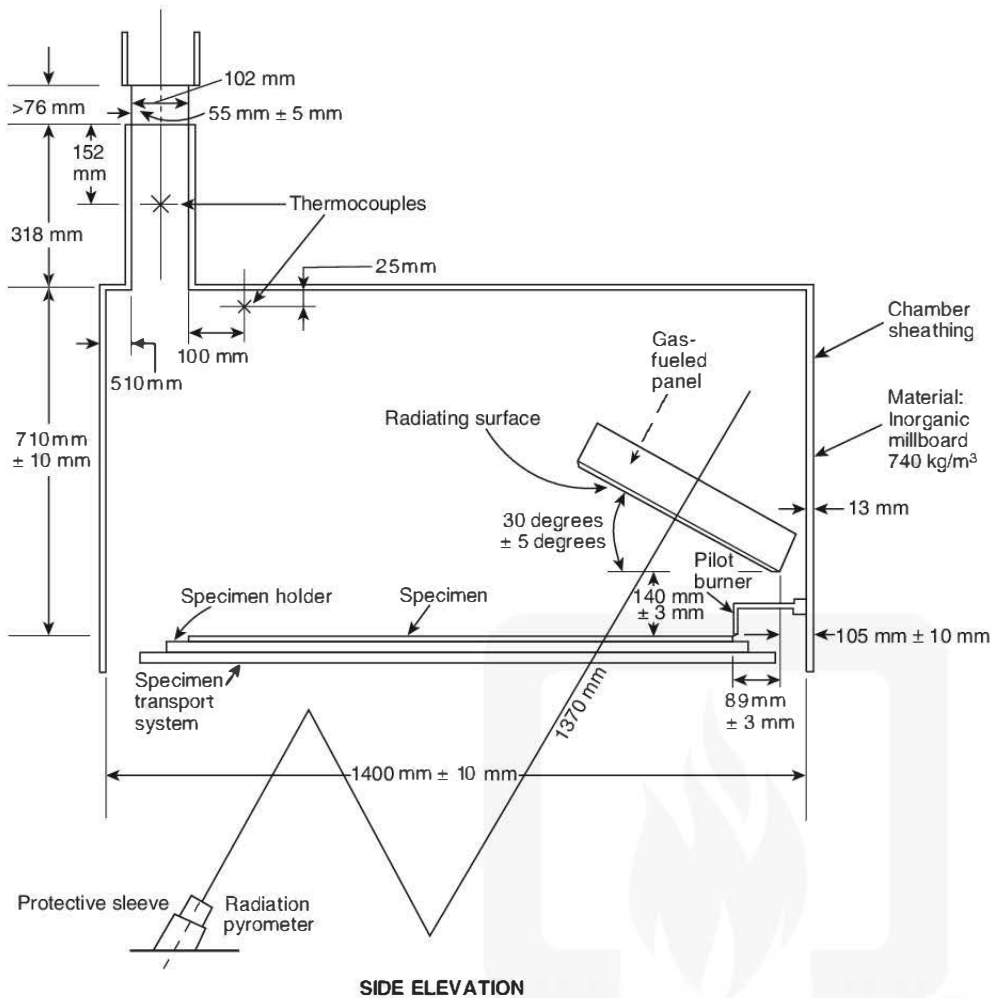


FIGURE 4.2.1(a) Side Elevation of Flooring Radiant Panel Tester Schematic.

4.2.3 The top of the chamber shall have an exhaust stack with interior dimensions of 102 mm \pm 3 mm wide \times 380 mm \pm 3 mm deep \times 318 mm \pm 3 mm high at the opposite end of the chamber from the radiant panel.

4.3 Radiant Heat Energy Source.

4.3.1 The radiant heat energy source shall be a panel consisting of a porous material mounted in a cast-iron frame or steel frame and having a radiation surface of 305 mm \times 457 mm.

4.3.2 The radiant heat energy source shall be capable of operating at temperatures up to 816°C.

4.3.3 The panel fuel system shall consist of the following:

- (1) Venturi-type aspirator for mixing gas and air at atmospheric pressure
- (2) Clean, dry air supply capable of providing 28.3 m³/hr at 76 mm of water column at normal temperature and pressure (NTP)
- (3) Instrumentation for monitoring and controlling the flow of fuel to the panel

4.3.4 The radiant heat energy panel shall be fired by propane, methane, or natural gas.

4.3.5 The radiant heat energy panel shall be mounted at an angle of 30 degrees \pm 5 degrees to the horizontal specimen plane.

4.3.5.1 The horizontal distance from the zero (0) mark on the specimen fixture to the bottom edge (projected) of the radiating surface of the panel shall be 89 mm \pm 0.3 mm.

4.3.5.2 The panel-to-specimen vertical distance shall be 140 mm \pm 0.3 mm [see Figure 4.2.1(a) and Figure 4.2.1(b)].

4.3.5.3 The angle and dimensions specified in 4.3.5 through 4.3.5.2 shall be followed to obtain the required radiant flux profile.

4.3.6 The radiation pyrometer for standardizing the thermal output of the panel shall be capable of viewing a circular area 178 mm to 254 mm in diameter at a nominal distance of 1.37 m.

4.3.7 The radiation pyrometer shall be calibrated over an operating blackbody temperature range of 490°C to 510°C.

4.3.8 A high impedance voltmeter or potentiometric voltmeter with a millivolt range shall be used to monitor the output of the radiation pyrometer described in 4.3.6.

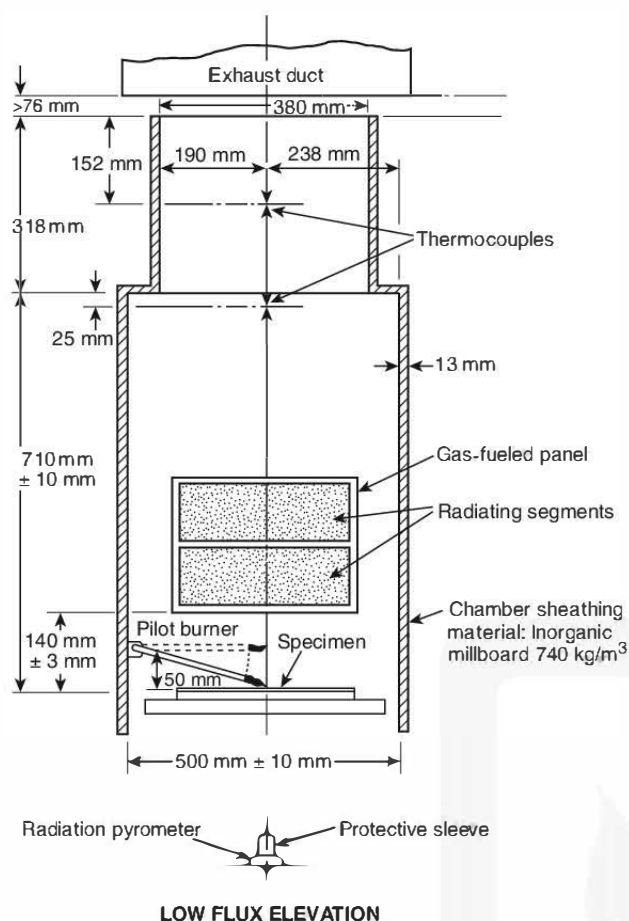


FIGURE 4.2.1(b) Low Flux Elevation of Flooring Radiant Panel Tester Schematic.

4.4* Specimen Holder. The specimen holder shall be constructed from heat-resistant stainless steel having a thickness of $1.98 \text{ mm} \pm 0.2 \text{ mm}$ and an overall dimension of $1140 \text{ mm} \times 320 \text{ mm} \pm 20 \text{ mm}$, as illustrated in Figure 4.4, with a specimen opening of $200 \text{ mm} \pm 3 \text{ mm} \times 1000 \text{ mm} \pm 15 \text{ mm}/-0 \text{ mm}$.

4.4.1 Six slots shall be cut in the flange on either side of the holder to reduce warping.

4.4.2 The holder shall be fastened to the platform with two stud bolts at each end.

4.5 Pilot Burner. The pilot burner used to ignite the specimen shall be a nominal 6 mm inside diameter, 10 mm outside diameter stainless steel tube line burner having 19 evenly spaced 0.7 mm diameter (No. 70 drill) holes drilled radially along the centerline and 16 evenly spaced 0.7 mm diameter (No. 70 drill) holes drilled radially 60 degrees below the centerline as illustrated in Figure 4.5.

4.5.1 In operation, the gas flow shall be adjusted to a flow rate of $0.085 \text{ m}^3/\text{hr}$ to $0.100 \text{ m}^3/\text{hr}$ (air scale).

4.5.2 With the gas flow adjusted in accordance with 4.5.1 and the pilot burner in the test position, the pilot flame shall extend nominally from $63.5 \text{ mm} \pm 10 \text{ mm}$ at either end to nominally $127 \text{ mm} \pm 10 \text{ mm}$ at the center.


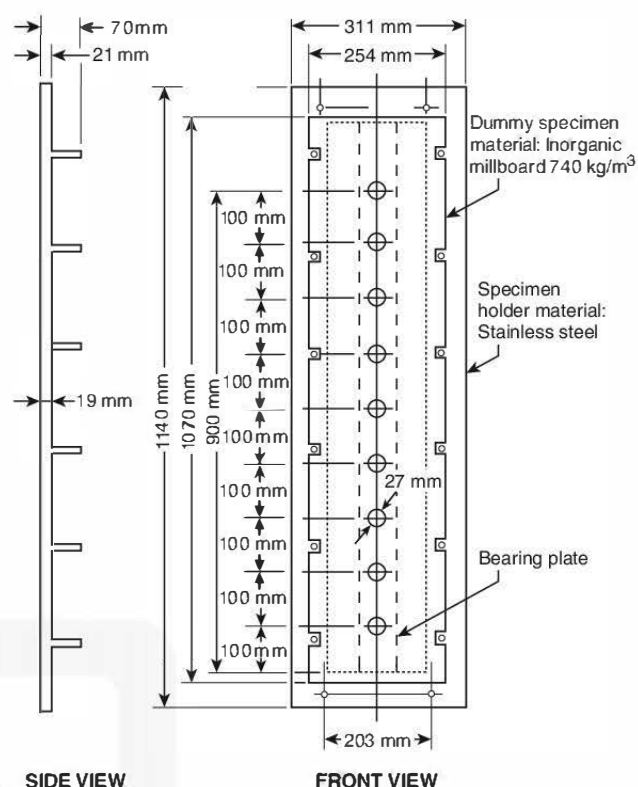


FIGURE 4.4 Dummy Specimen in Specimen Holder.

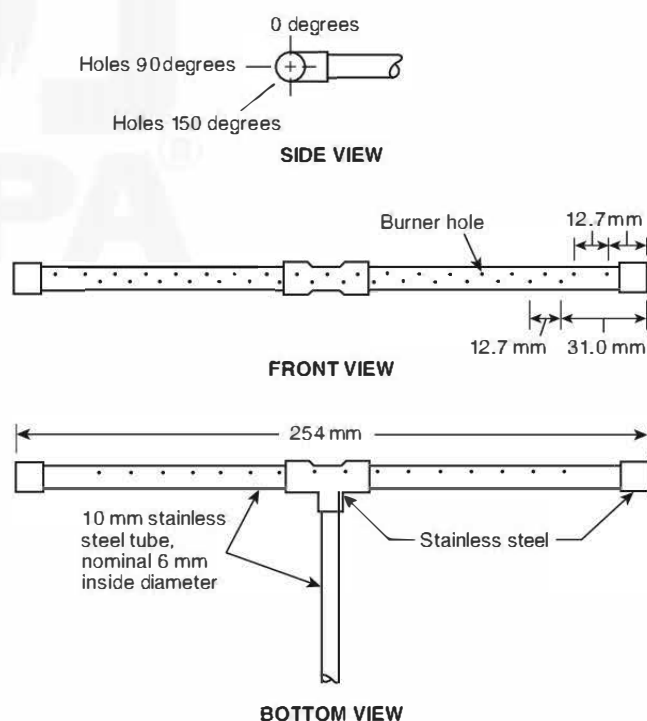

Notes:

1. All holes No. 70; drill 0.7 mm diameter.
2. All joints silver soldered, heliarc'd, or otherwise appropriately sealed.

FIGURE 4.5 Pilot Burner.

4.5.3 The pilot burner shall be positioned no more than 5 degrees from the horizontal so that the flame generated impinges on the specimen at the zero (0) distance burned point [see Figure 4.2.1(a) and Figure 4.2.1(b)].

4.5.4 When not being applied to the specimen, the burner shall be capable of being moved at least 50 mm away from the specimen.

4.5.5 The holes in the pilot burner shall be kept clean.

4.5.6 A soft wire brush shall be used to remove surface contaminants.

4.5.7 Nickel-chromium or stainless steel wire or its equivalent with an outside diameter of 0.5 mm shall be used for opening the holes.

4.6 Thermocouples.

4.6.1 A 3.2 mm stainless steel-sheathed, grounded junction, Chromel-Alumel thermocouple shall be located in the flooring radiant panel test chamber. [See Figure 4.2.1(a) and Figure 4.2.1(b).]

4.6.1.1 The thermocouple shall be kept clean to ensure the accuracy of the readout.

4.6.1.2 The chamber thermocouple shall be located in the longitudinal central vertical plane of the chamber 25 mm down from the top and 102 mm back from the inside of the exhaust stack.

4.6.2 An indicating potentiometer with a range of 100°C to 500°C shall be used to determine the chamber temperature prior to the test.

4.7* Exhaust Hood.

4.7.1 An exhaust duct meeting the following criteria shall be used to remove combustion products from the chamber:

- (1) It shall have a capacity of 28.3 NTP m³/min to 85 NTP m³/min, decoupled from the chamber stack by at least 76 mm on all sides.
- (2) It shall have an effective canopy area larger than the plane area of the chamber with the specimen platform in the out position.

4.7.2 Prior to igniting the panel, the airflow rate shall be 76.2 m/min \pm 15.2 m/min when measured as follows:

- (1) A dummy specimen shall be in place.
- (2) The temperature of the airflow through the exhaust duct shall be at room temperature.
- (3) A hot wire anemometer with an accuracy of ± 0.1 m/sec shall be used for this measurement.
- (4) The hot wire anemometer shall be inserted into the center of the stack opening at a distance of 152 mm down from the top of the stack opening.
- (5) The hot wire anemometer

4.7.3 The hot wire anemometer shall have an accuracy of ± 0.1 m/sec.

4.8 Dummy Specimen.

4.8.1 The dummy specimen, which is used in the flux profile determination, shall be made of 19 mm inorganic calcium silicate board with a nominal density of 740 kg/m³ (see Figure 4.4).

4.8.2 The specimen shall measure 250 mm \times 1070 mm with 27 mm diameter holes located on the centerline at points ranging from 100 mm to 900 mm, spaced in 100 mm increments, starting at the maximum flux end of the specimen.

4.8.3 To provide proper and consistent seating of the flux meter in the hole openings, a stainless steel or galvanized steel bearing plate shall be mounted and secured firmly to the underside of the calcium silicate board with holes corresponding to those specified in 4.8.1.

4.8.3.1 The bearing plate shall run the length of the dummy specimen and shall have a minimum width of 76 mm.

4.8.3.2 The thickness of the bearing plate shall vary to maintain the flux meter height specified in 6.1.7.1 up to the maximum of 3.2 mm.

4.8.3.3* The total heat flux transducer used to determine the flux profile of the chamber in conjunction with the dummy specimen (see 4.3.8) shall have a range of 0 W/cm² to 1.5 W/cm² and shall be calibrated over the operating flux level range of 0.10 W/cm² to 1.5 W/cm².

4.8.3.4 A source of cooling water 15°C to 25°C shall be provided for the total heat flux transducer.

4.8.3.5 A high impedance voltmeter or potentiometric voltmeter with a range of 0 mV to 10 mV and reading to 0.01 mV shall be used to measure the output of the total heat flux transducer during the flux profile determination.

4.9 Timer. A timer reading to the nearest 0.1 minute shall be used to measure preheating, pilot contact, and flameout times.

Chapter 5 Test Specimens

5.1 Sampling Procedure. The sample selected for testing shall be representative of the product.

5.2* Specimen Size and Mounting.

5.2.1 The test specimen shall be a floor covering system sized to provide for adequate clamping in the mounting frame.

5.2.1.1 The specimen's minimum dimensions shall exceed the frame width (200 mm nominal) and length (1000 mm nominal) by about 50 mm.

5.2.1.2 Holes shall be made in the specimen to accommodate the mounting frame bolts. (See Figure 4.4.)

5.2.2 The floor covering system specimen shall simulate actual installation practice.

5.2.3 Standard Simulated Concrete Floor. Where a standard simulated concrete floor is used, it shall consist of a fiber cement board with the following specifications:

- (1) The board shall be uncoated.
- (2) The board shall be nominally 6.3 mm thick.
- (3) The board shall have a density of 1442 kg/m³ \pm 160 kg/m³.
- (4) The board shall meet the requirements of either ASTM C1186, *Standard Specification for Flat Fiber-Cement Sheets, Grade II*, or ASTM C1288, *Standard Specification for Fiber-Cement Interior Substrate Sheets*.

- (5) The board shall not be required to meet the requirements of ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*.

5.2.4 Carpet.

5.2.4.1 Simulated Carpet and Cushion Pad Over Concrete. Carpet specimens shall be cut in the machine direction. The specimen holder shall be inverted on a clean, flat surface and the test specimen then inserted into the holder.

(A)* The cushion pad shall be inserted with the pattern side facing the carpet, followed by nominal 6.3 mm thick fiber cement board complying with 5.2.3 and an inorganic millboard a nominal thickness of 13 mm and a nominal density of 0.74 g/cm³.

(B) The steel bar clamps shall be placed across the assembly and tightened. The test assembly shall be mounted on the specimen transport frame so that the pile lay faces the panel.

5.2.4.2 Simulated Carpet With or Without Integral Cushion Pad Bonded to Concrete. Carpet specimens shall be cut in the machine direction. The adhesive used shall be that recommended by the carpet manufacturer. In the absence of a manufacturer's recommendation, a multipurpose adhesive typical of commercial installation shall be selected by the laboratory.

(A) The adhesive shall be applied to the smooth side of the fiber cement board complying with 5.2.3 in accordance with the directions provided by the adhesive manufacturer. In the absence of a manufacturer's recommendation, the adhesive shall be applied with a 32 mm V-notched trowel. A nominal 9.1 kg roller with a diameter of 76 mm and a width as close as practical to that of the specimen shall be used to apply the adhesive across the top of the specimen to ensure good contact with the substrate.

(B)* Specimens shall be permitted to be stacked under a dead load after bonding specimens to the fiber cement board for no more than 24 hours prior to conditioning. The specimen shall be mounted in the testing frame in accordance with 5.2.4.1 and shall be tested in accordance with standard procedure.

5.2.4.3 Other Carpet. The actual subfloor shall be permitted to be substituted for the standard fiber cement board substrate.

5.2.5 Tiles.

5.2.5.1 Samples shall represent the largest dimension tile manufactured.

5.2.5.2 Samples selected from roll or sheet goods prior to cutting into tiles shall be permitted as an alternative to 5.2.5.1. The test results are applicable to identical tiles of smaller dimensions.

5.2.5.3 The specimen shall be mounted so that the first joint is located at the farthest distance from the zero point.

5.2.5.4 Where the tile is not wide enough to cover the width of the specimen holder, the tile shall be mounted to include a longitudinal joint at the center line of the specimen holder.

5.2.5.5 Where the tiles are not glued, the edges of the specimen shall be mechanically secured to the substrate.

5.2.6 Planks, Tiles, Cove, or Base. A flooring material intended for installation in the form of planks, tiles, cove, or base having an overall width greater than the opening in the speci-

men holder, 200 mm, shall include at least one longitudinal joint located at the approximate centerline of the specimen holder. For materials having a width less than the opening of the specimen holder, 200 mm, the joints shall be located as necessary to complete the specimen assembly.

5.2.7* Resilient Flooring. Commercial installation practice shall be followed or simulated or both.

5.2.7.1 The laminate specimens shall be prepared with a longitudinal seam near the centerline of the specimen holder and shall conform to the following:

- (1) The manufacturer recommendations for sealing the seams shall be followed.
- (2) The laminate and the proposed cushion shall be conditioned in accordance with Section 5.3 for a minimum of 48 hours.
- (3) Laminate specimens shall be mounted by inverting the specimen holder on a clean, flat surface.
- (4) Test specimens shall be placed in the specimen holder.
- (5) The cushion pad recommended by the manufacturer shall be mounted with the pattern side facing the laminate followed by a fiber-cement board complying with 5.2.3 and inorganic millboard with a nominal 13 mm thickness and a nominal density of 0.58 g/cm³.
- (6) Steel bar clamps shall be placed across the assembly and tightened firmly.
- (7) The test assembly shall be mounted on the specimen transport frame so that the laminate decor layer faces the panel.

5.2.7.2 Laminate with an attached cushion shall be mounted without the addition of a separate cushion.

5.2.7.3 Where a specified cushion is absent, a closed-cell foam pad with a thickness of 1.5 to 2.5 mm and a density of 35 ± 5 kg/m³ shall be used.

5.2.8 Laminate Flooring. Laminate flooring shall be mounted over the proposed cushion or simulated concrete subfloor.

5.2.8.1 The laminate specimens shall be prepared with a longitudinal seam near the centerline of the specimen holder and shall conform to the following:

- (1) The manufacturer recommendations for sealing the seams shall be followed.
- (2) The laminate and the proposed cushion shall be conditioned in accordance with Section 5.3 for a minimum of 48 hours.
- (3) Laminate specimens shall be mounted by inverting the specimen holder on a clean, flat surface.
- (4) Test specimens shall be mounted in the specimen holder.
- (5) The cushion pad recommended by the manufacturer shall be mounted with the pattern side facing the laminate followed by a fiber-cement board complying with 5.2.3 and inorganic millboard with a nominal 13 mm thickness and a nominal density of 0.58 g/cm³.
- (6) Steel bar clamps shall be placed across the assembly and tightened firmly.
- (7) The test assembly shall be mounted on the specimen transport frame so that the laminate decor layer faces the panel.

5.2.8.2 Laminate with an attached cushion shall be mounted without the addition of a separate cushion.

5.2.8.3 Where a specified cushion is absent, a closed-cell foam pad with a thickness of 1.5 to 2.5 mm and a density of $35 \pm 5 \text{ kg/m}^3$ shall be used.

5.2.9 Hardwood Flooring. Hardwood floor shall be nailed to a plywood subfloor, sanded, and finished in accordance with standard practice.

5.2.9.1 Commercial installation practice shall be followed or simulated or both.

5.2.9.2 Where a typical system is used, the substrate shall be a 16 mm plywood sheet covered with building paper. The oak flooring strips shall be nailed to the plywood and then sanded, sealed, and waxed.

5.2.9.3 The assembly shall be tested with the moisture content of the oak at 7 percent to 8 percent.

5.2.10 Number of Specimens. A minimum of three specimens per sample shall be tested.

5.3 Specimen Conditioning. Test specimens shall be conditioned at $21^\circ\text{C} \pm 3^\circ\text{C}$ and a relative humidity of 50 percent ± 5 percent horizontally or vertically in open racks for optimum air circulation for a minimum of 48 hours.

5.3.1 Carpet specimens that have been glued down shall be conditioned for a minimum of 96 hours.

Chapter 6 Radiant Heat Energy Flux Profile Standardization

6.1 Procedure.

6.1.1 In a continuing program of tests, the flux profile shall be determined at least weekly.

6.1.2 Where the time interval between tests is greater than 1 week, the flux profile shall be determined at the start of the test series.

6.1.3 The dummy specimen shall be mounted in the mounting frame, and the assembly shall be attached to the sliding platform.

6.1.4 With the sliding platform outside the chamber, the radiant panel shall be ignited.

6.1.4.1 The unit shall heat for $1\frac{1}{2}$ hours.

6.1.4.2 The pilot burner shall be off during the flux profile determination.

6.1.4.3 The fuel mixture shall be adjusted to provide an air-rich flame.

6.1.4.4 Fuel flow shall be set to bring the panel blackbody temperature to $500^\circ\text{C} \pm 10^\circ\text{C}$, and the chamber temperature shall be recorded.

6.1.5 When equilibrium has been established, the specimen platform shall be moved into the chamber and the door shall be closed.

6.1.6 The closed chamber shall be allowed to equilibrate for 30 minutes.

6.1.7 The radiant heat energy flux level shall be measured at the 400 mm point with the total flux meter instrumentation.

6.1.7.1 The measurement specified in 6.1.8 shall be accomplished by inserting the flux meter into the opening so that its detecting plane is 1.6 mm to 3.2 mm above and parallel to the plane of the dummy specimen and then reading its output after $30 \text{ seconds} \pm 10 \text{ seconds}$.

6.1.7.2 If the level is within the limits specified in 6.1.8, the flux profile determination shall be started.

6.1.7.3 If the level is not within the limits specified in 6.1.8, the necessary adjustments in panel fuel flow shall be made.

6.1.7.4 Data shall be recorded in a data log. (*See Annex B.*)

6.1.8 The test shall be run under chamber operating conditions that provide a flux profile as shown in Figure 1.4.3, and the radiant heat energy incident on the dummy specimen shall be as follows:

- (1) Between 0.87 W/cm^2 and 0.95 W/cm^2 at the 200 mm point
- (2) Between 0.48 W/cm^2 and 0.52 W/cm^2 at the 400 mm point
- (3) Between 0.22 W/cm^2 and 0.26 W/cm^2 at the 600 mm point

6.1.9 The flux meter shall be inserted into the 100 mm opening following the procedure outlined in 6.1.7.

6.1.9.1 The millivolt (mV) output shall be read at $30 \text{ seconds} \pm 10 \text{ seconds}$.

6.1.9.2 The procedure outlined in 6.1.9 shall be repeated at the 200 mm point.

6.1.9.3 The 300 mm to 900 mm flux levels shall be determined in the manner specified in 6.1.9.

6.1.9.4 Following the 900 mm measurement, a reading check shall be made at 400 mm to verify that the test chamber is in calibration when it is within the limits set forth in 6.1.8 and the profile determination is completed.

6.1.9.5 If the calibration requirement of 6.1.9.4 cannot be achieved, the fuel flow shall be adjusted, allowing 30 minutes for equilibrium, and the procedure shall be repeated.

6.1.10 The radiant heat energy flux data shall be plotted as a function of distance along the specimen plane.

6.1.10.1 A smooth curve shall be developed by drawing through the data points.

6.1.10.2 The curve developed in 6.1.10.1 shall be designated the flux profile curve.

6.1.11 The open chamber temperature and the radiant panel blackbody temperature identified with the standard flux profile shall be determined by opening the door and moving the specimen platform outside the chamber.

6.1.11.1 The chamber shall be allowed to equilibrate for 30 minutes.

6.1.11.2 The chamber temperature and the optical pyrometer output that indicate the panel blackbody temperature shall be read and recorded in degrees Celsius.

6.2 Calibration of Radiation Instrumentation.

6.2.1 Radiation Pyrometer.

6.2.1.1 The radiation pyrometer shall be calibrated by means of a conventional blackbody enclosure placed within a furnace and maintained at the three following uniform temperatures: 490°C ($\pm 2^\circ\text{C}$), 500°C ($\pm 2^\circ\text{C}$), and 510°C ($\pm 2^\circ\text{C}$).

6.2.1.2 The blackbody enclosure shall consist of a closed chromel metal cylinder with a small sight hole at one end.

6.2.1.3 The radiation pyrometer shall be located on the opposite end of the cylinder where a thermocouple indicates the blackbody temperature, with the thermocouple placed within a drilled hole and in good thermal contact with the blackbody.

6.2.1.4 The output of the radiation pyrometer shall be read when the blackbody enclosure has reached the appropriate temperature equilibrium.

6.2.1.5 The same procedure shall be used at each of the temperatures indicated in 6.2.1.1.

6.2.1.6* An acceptable alternative to the procedure in 6.2.1.1 through 6.2.1.5 shall be the use of an outside agency accredited by a recognized accreditation body.

6.2.2 Total Heat Flux Meter.

6.2.2.1 The total heat flux meter shall be calibrated using transfer calibration methods for comparison with a dedicated calibrated flux meter provided by an outside agency that is accredited by a recognized accreditation body.

6.2.2.2 The total heat flux meter calibration shall use the flooring radiant panel test apparatus as the heat source.

6.2.2.3 Measurements shall be made at each of the nine dummy specimen positions described in Section 4.8 and the mean value of these results shall constitute the final calibration.

6.2.2.4 The laboratory shall maintain a dedicated calibrated reference flux meter to be used exclusively for comparison with any one or more working flux meters when needed.

6.2.2.5 The working flux meters shall be calibrated at least annually.

6.2.3 Potentiometer.

6.2.3.1 The indicating potentiometer used to measure the output of the radiation pyrometer (in 6.2.1) and the total heat flux meter (in 6.2.2) shall be calibrated at least once per year.

6.2.3.2 The potentiometer shall be calibrated using a calibrator with a minimum resolution of 0.01 mV.

6.2.3.3 The calibrator in 6.2.3.2 shall be traceable to an outside agency accredited by a recognized accreditation body.

6.2.3.4* An acceptable alternative to the procedure in 6.2.3.1 through 6.2.3.3 shall be the use of an outside agency accredited by a recognized accreditation body.

Chapter 7 Test Procedure

7.1 Pretest Heating. With the sliding platform outside the chamber, the radiant panel shall be ignited.

7.1.1 The unit shall be allowed to heat for 1½ hours.

7.1.2 A sheet of inorganic millboard, such as calcium silicate or the equivalent, shall be used to cover the opening when the hinged portion of the front panel is open and the specimen platform is moved out of the chamber.

7.1.3 The millboard specified in 7.1.2 shall be used to prevent heating of the specimen and to protect the operator.

7.1.4 The panel blackbody temperature and the chamber temperature shall be read.

7.1.5 If the temperature readings specified in 7.1.4 are within $\pm 5^\circ\text{C}$ of those determined in accordance with 6.1.11, the chamber shall be considered ready for use.

7.2 Sample Mounting. The sample holder shall be inverted on a workbench, and the flooring system shall be inserted.

7.2.1 The steel bar clamps shall be placed across the back of the assembly, and the nuts shall be tightened firmly.

7.2.2 The sample holder shall be returned to its upright position, the test surface shall be cleaned with a vacuum, and the sample holder shall be mounted on the specimen platform.

7.2.3 Carpet specimens shall be brushed to raise the pile to its normal position.

7.3 Ignition of Pilot Burner. The following steps shall be taken:

- (1) The pilot burner shall be ignited and kept at least 50 mm away from the specimen.
- (2) The specimen shall be moved into the chamber and within 3 seconds the door shall be closed and the timer started. This is time zero.

7.3.1 The timer shall be started.

7.3.2 After 5 minutes, the chamber shall be considered to be preheated.

7.3.3 With the pilot burner on and at least 50 mm away from the specimen, the pilot burner flame shall be brought into contact with the specimen at the zero (0) mm mark.

7.3.4 The pilot burner flame shall remain in contact with the specimen for 5 minutes.

7.3.5 The pilot burner then shall be removed to a position at least 50 mm away from the specimen, and the pilot burner flame shall be extinguished.

7.4 Flame Propagation of Specimen. If the specimen does not propagate flame within 5 minutes following pilot burner flame application, the test shall be terminated.

7.4.1 For specimens that do propagate flame, the test shall be continued until the flame goes out or until the flame front advances the full length of the specimen.

7.4.2 Significant phenomena such as melting, blistering, and penetration of flame to the substrate shall be observed and recorded.

7.5 Completion of Test.

7.5.1 When the test is completed, the door shall be opened and the specimen platform shall be pulled out.

7.5.2 The protective inorganic millboard sheet shall be put in place.

7.6 Data Collection and Recording. The distance burned shall be measured (i.e., the point of farthest advance of the flame front to the nearest 1 mm).

7.6.1 The distance to W/cm^2 critical radiant heat flux at flameout shall be converted from the flux profile curve.

7.6.2 Data shall be recorded in a data log. (See Annex B.)

7.7 Removal of Specimen. The specimen and its mounting frame shall be removed from the movable platform.

7.8 Subsequent Testing.

7.8.1 The subsequent test shall be started as soon as the panel blackbody temperature and the chamber temperature are verified (see 6.1.11).

7.8.2 The test assembly shall be at room temperature prior to startup.

7.9 Extent of Flame Travel After a Prescribed Period.

7.9.1 Where the extent of flame travel after a prescribed burning period (e.g., 15 minutes) is measured for fire hazard assessment purposes, it shall be performed using the metal scale in accordance with 7.9.2.

7.9.2 A metal scale marked at 10 mm intervals shall be installed on the back of the platform or on the back wall of the chamber.

7.9.3 The distance measured in 7.9.1 shall be converted into a radiant flux.

Chapter 8 Calculations

8.1 General.

8.1.1 Results obtained from all specimens tested shall be reported.

8.1.2 Three specimens for the calculations shall be selected, and an explanation of why they were chosen shall be provided.

8.1.3 The mean, the standard deviation, and the coefficient of variation of the critical radiant flux test data on all specimens shall be calculated.

8.2 Formulas. The following formulas shall be used:

[8.2]

$$S = \sqrt{\frac{(\sum X^2 - n\bar{X}^2)}{n-1}} \text{ and } V = \frac{S}{\bar{X}} \times 100$$

where:

S = estimated standard deviation

X = value of single observation

n = number of observations

\bar{X} = arithmetic mean of the set of observations

V = coefficient of variation

Chapter 9 Report

9.1 Required Information. The report shall include the following:

- (1) Description of the floor covering system tested, including its elements
- (2) Description of the procedure used to assemble the floor covering system specimen
- (3) Number of specimens tested
- (4) Individual values of critical radiant flux
- (5) Average critical radiant flux, standard deviation, and coefficient of variation
- (6) Observations of the burning characteristics of the specimen during the testing exposure, such as premature ignition during the initial 5-minute heating period, delamination, melting, sagging, and shrinking
- (7) For tiles, the finished dimensions of the tile tested and a statement that test results are applicable to tiles of smaller dimensions
- (8) The extent of flame travel and radiant flux after a prescribed period, if measured

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1.1 This test method is technically similar to ASTM E648, *Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source*, and test results obtained with this test method should be considered equivalent to test results obtained using ASTM E648. Multiple codes and standards, including NFPA 101 and NFPA 5000, reference both test methods in the same section.

A.1.1.2 The imposed radiant flux simulates the thermal radiation levels likely to impinge on the floors of a building whose upper surfaces are heated by flames, hot gases, or both from a fully developed fire in an adjacent room or compartment.

A.1.2.1 Annex D provides information on the proper application and interpretation of the results of this test.

A.1.3.3 Specific safety precautions are provided in Annex E.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment, or materials, the "authority having jurisdiction" may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The "authority having jurisdiction" may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.3.3 Flameout. See Section 7.6.

A.4.4 An acceptable heat-resistant stainless steel is AISI Type 300 (UNA-N08 330) or equivalent. This reference is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees.

A.4.7 An acceptable anemometer is an Omega HH-615 HT hot-wired anemometer manufactured by Omega Engineering Inc., Stamford, CT. This reference is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees.

A.4.8.3.3 An acceptable heat flux transducer is a Schmidt-Boelter-type Medtherm 64-2-20 manufactured by Medtherm Corporation, Huntsville, AL. This reference is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees.

A.5.2 Typical examples of floor covering systems are as follows:

- (1) Hardwood floor nailed to a plywood subfloor that is sanded and finished according to standard practice
- (2) Carpet with or without integral cushion pad bonded to a high-density inorganic sheet simulating a concrete subfloor
- (3) Carpet mounted over the actual cushion pad or carpet mounted over the actual subfloor to be used in the installation
- (4) Resilient floor bonded to a high-density inorganic sheet simulating a concrete subfloor
- (5) Laminate floor mounted over the proposed cushion or simulated concrete floor

A.5.2.4.1(A) It should be noted that fiber cement board could spall during a test. This can be avoided by heating the board for 12 hours at 163°C.

A.5.2.4.2(B) See Section 5.3 for conditioning requirements.

A.5.2.7 In most instances, this type of installation practice necessitates bonding to the standard fiber cement substrate.

A.6.2.1.6 Examples of recognized accreditation bodies include the National Institute of Standards and Technology (NIST) and calibration laboratories accredited to ISO/IEC 17025, *General requirements for the competence of testing and calibration laboratories*, by an accreditation body complying with ISO/IEC 17011, *Conformity assessment — Requirements for accreditation bodies accrediting conformity assessment bodies*. Calibration laboratories should be accredited by an accreditation body recognized by the International Laboratory Accreditation Cooperation (ILAC).

A.6.2.3.4 Examples of recognized accreditation bodies are the National Institute of Standards and Technology (NIST) and calibration laboratories accredited to ISO/IEC Standard 17025, *General requirements for the competence of testing and calibration laboratories*, by an accreditation body complying with ISO/IEC Standard 17011, *Conformity assessment — Requirements for accrediting conformity assessment bodies*. Calibration laboratories should be accredited by an accreditation body recognized by the International Laboratory Accreditation Cooperation (ILAC).

Annex B Sample Data Logs

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 Data Logs. Sample data logs for a radiant flux profile and a flooring radiant panel test are provided in Figure B.1 (a) and Figure B.1 (b).

RADIANT FLUX PROFILE DATA LOG

Date _____

Blackbody temperature _____ mV _____ °C

Gas flow _____ NTP m³/hr

Airflow _____ NTP m³/hr

Room temperature _____ °C

Pressure: Air _____ cm of H₂O; gas _____ cm of H₂O

Flux meter		Conversion factor
No. _____		from calibration
		on _____

Distance (cm)	mV	W/cm ²
10	_____	_____
20	_____	_____
30	_____	_____
40	_____	_____
60	_____	_____
70	_____	_____
80	_____	_____
90	_____	_____

Signed _____

FIGURE B.1(a) Sample Data Log for Radiant Flux Profile.

FLOORING RADIANT PANEL TEST DATA LOG

Test No. _____ Date _____ Time _____
Laboratory _____
Specimen identification/code No. _____

Test Assembly

Panel: Angle _____ degrees; temperature _____ °C
Flow: Gas _____ NTP m³/hr; air _____ NTP m³/hr

Pressure, Initial

Air _____ cm of H₂O; gas _____ cm of H₂O

Chamber Temperature

Initial _____ °C; maximum _____ °C
Room temperature _____ °C
Hood draft _____ cm of H₂O

Flame Front Advance					
Distance (cm)	Time (minutes)				
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____

Total burn length _____ cm
Critical radiant flux _____ W/cm²
Flame front out _____ minutes; flux profile reference _____
All flame out _____ minutes
Observations _____

Signed _____

FIGURE B.1(b) Sample Data Log for Flooring Radiant Panel Test.

Annex C Commentary on Critical Radiant Flux Test

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

C.1 Introduction.

C.1.1 The development and behavior of fires in buildings and rooms or compartments are complex phenomena and are not well understood. As a result, efforts to establish safety requirements must, for the present, be based on the selection and use of those components of the fire system that could become involved and that can be regulated. These efforts, together with experienced engineering rationale, must serve until a more valid technical basis for fire engineering design has been determined.

C.1.2 When fire develops in a building, experience suggests that traditional floor covering systems seldom serve as a medium for fire spread during the early stages of a fire. During several fires in the early 1970s, floor covering materials in corridors became involved for considerable distances. The test method described in this standard has been recommended as a means to control potential fire spread in floor covering systems.

C.1.3 Because the quantity and nature of room furnishing items cannot, at present, be controlled with regard to fire involvement of the full room, it is necessary to assume that floor involvement can and will, on occasion, occur. It is appropriate to recommend the application of only those floor covering systems that meet high levels of resistance to fire involvement based on critical radiant flux for use in corridors. Building codes cover interior finish in general, and it appears that only in corridors do the requirements for floor covering systems need to be more restrictive.

C.1.4 This annex is intended to provide information on the technical relevance of the test method to the problem of fires. It is intended to provide both the technical audience and the lay public with a basis for interpreting the significance and limitations of the data resulting from the test.

C.2 Nature of the Test.

C.2.1 Convective heat flow cannot serve as a major feedback mechanism in most cases of fires that involve floor covering systems, because of the buoyancy of the flames and hot gases. Therefore, the horizontal surfaces of building finishes seldom have been recognized as primary hazards in the spread of flames. However, corridor fire tests conducted at the National Institute of Standards and Technology (NIST), together with building fire incidents, indicate that fire spread can occur in corridors exposed to burnout conditions in adjacent rooms. [1, 2]

C.2.1.1 Fires were observed to propagate the full length of the corridor where little, if any, combustible material other than the floor covering system was involved in the corridor finish. Analysis of the measurements made during such tests has made clear the importance of radiant heat transfer from upper corridor surfaces, flame, smoke, and gases in serving a fire support role. Therefore, the sensitivity of a floor covering system to the radiant support of combustion is recommended as a basis for ranking floor covering systems with respect to fire behavior. [3, 4]

C.2.1.2 Critical radiant flux, the heat flux level below which surface flame spread will not occur, was selected as the fire

property of controlling importance for a floor covering system. If a room fire does not impose a radiant flux that exceeds this critical level on a corridor floor covering system, flame spread will not occur.

C.2.2 Critical radiant flux does not provide information on the irradiance level to which the flooring is exposed when fire occurs. Irradiance level is influenced largely by other variables, which include the following:

- (1) Nature, quantity, and arrangement of the fire load in the compartment where ignition occurs
- (2) Ventilation conditions in the portion of the building that becomes exposed to fire
- (3) Geometry of the compartment and ventilation passages
- (4) Heat release rate of the fire load and the floor covering system
- (5) Heat capacity of the enclosing walls, ceiling, and floor

C.3 Experimental Studies of Relevance.

C.3.1 One important fire property of floor covering systems has been identified that, if the effective irradiance level can be predicted when fire occurs, can provide information on the extent of fire spread possibility. The use of this property alone, at least in some cases, is inadequate for the prediction of fire spread under severe exposure conditions. An example follows in C.3.1.1.

C.3.1.1 Figure C.3.1.1 shows a plot of the maximum heat flux to the floor surface of the NIST full-scale corridor with four 18 kg cribs in the burn room and with no combustible floor covering system or other interior finish present in the corridor. These data were obtained with a fire load in the adjoining room of 10.7 kg/m² with a measured burning rate (maximum) of 80 g/sec. The two curves show the envelope resulting from two series of experiments.

C.3.1.2 The data plotted as circles on Figure C.3.1.1 represent the critical radiant flux of 12 floor covering systems versus the extent of flame propagation in the corridor as tested using the full-scale tests. [5] In all cases, the heat flux to the floor covering system at the doorway between the room and the corridor was higher than the critical radiant flux for the material.

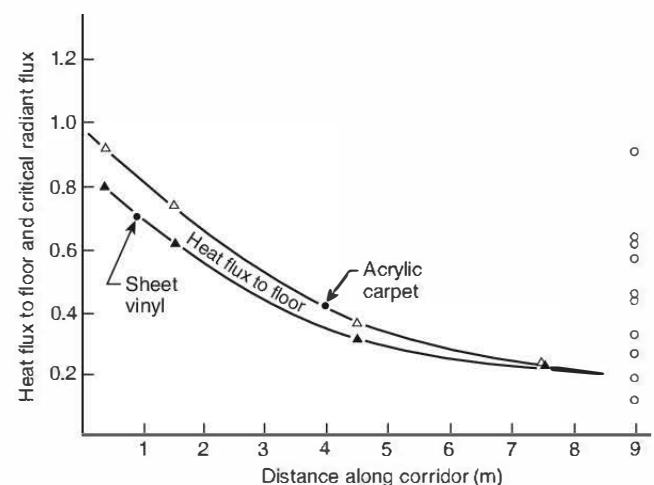


FIGURE C.3.1.1 Critical Radiant Flux of Various Floor Covering Systems Versus the Extent of Flame Propagation in the Corridor.

Therefore, flame spread should be expected to include involvement of the corridor, and that was observed.

C.3.2 It is evident that only two of the 12 floor covering systems stopped burning at distances corresponding to their critical radiant flux as shown on the flux-distance curve for the corridor without combustible linings. The reason for this difference in behavior is that, apparently, the flux to the floor surface was sufficiently augmented by the heat release from the flooring itself after rapid flame spread commenced. This usually followed a period of relatively slow flame spread away from the doorway.

C.3.2.1 In addition, it seems likely that changes in ventilation of the compartment fire could have modified the location at which pyrolysis gases burn (i.e., in the corridor above the floor) and influenced the flame height of the floor fire. These effects greatly increased the radiant flux incident on the floor.

C.3.2.2 To date, the effects noted in C.3.2 and C.2.1 are not well understood, and no firm guidance can be provided on the way they should be introduced to predict the overall behavior of such a fire system.

C.3.3 Other data are available to illustrate the merit of the test under less severe exposure. These data are the result of a series of experiments involving crib or furniture item fires in a room 2.4 m in height with an open door measuring 3.4 m × 2.7 m that had been fitted with floor covering assemblies of known critical radiant flux characteristics. In these tests, the crib or furniture and the floor covering assembly were the only combustibles in the room.

C.3.4 The results of this study have been published, and Figure C.3.4 shows some of the data developed. [6] The curve shown in Figure C.3.4 illustrates the extent of fire propagation from the source as a function of critical radiant flux.

C.3.4.1 The four floor covering systems used were carpets that all qualified as having passed the pill test. The data are interesting, because they show that, under the conditions of the experiments, the distance of fire propagation is inversely related to critical radiant flux.

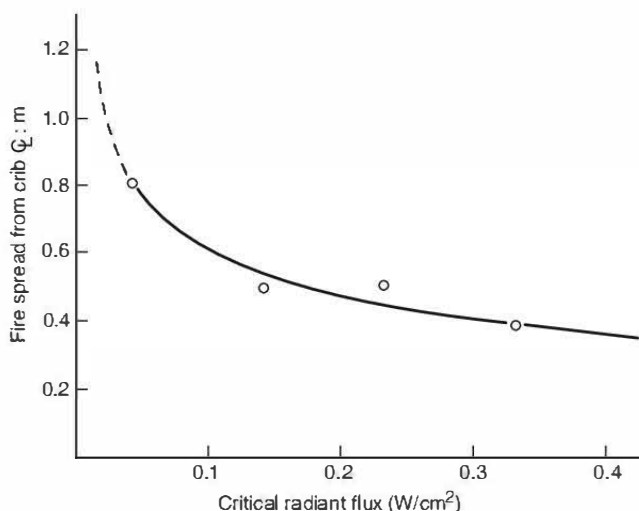


FIGURE C.3.4 Room Burn Tests — Fire Spread from 6.4 kg Crib.

C.3.4.2 In addition, while not demonstrated by this curve, the data show that the burning ceased at positions on the floor covering system somewhat below those at which flux measurement during the test corresponded to the critical radiant flux of the floor covering system being studied. Therefore, in this situation, which did not involve room flashover, critical radiant flux appears to provide a method of ranking the fire spread behavior of the carpets.

C.3.5 The current version of this test procedure is a result of a recent study conducted at NIST. [7] The purpose of this work was to resolve a perceived problem with ignitability of and continued flame propagation across some carpet specimens and to reduce the variability of test results obtained by different laboratories. As a result, the following three significant changes were made in the standard:

- (1) New provisions on specimen preparation and conditioning
- (2) Tighter control of the airflow through the chamber during calibration and conduct of the test
- (3) Replacement of the propane torch pilot burner with a propane line burner

C.3.5.1 The ignitability and flame propagation issues appear to have been resolved with the use of the new line burner. The variability of test results among different laboratories has been shown to be markedly improved by the aforementioned changes in the standard, at least for one carpet fabric.

C.3.5.2 Previous proficiency rounds performed by the National Voluntary Laboratory Accreditation Program resulted in coefficients of variation ranging from 18 percent to 35 percent; the coefficient of variation obtained using the revised standard was less than 12 percent. A complete discussion of the research conducted by NIST can be found in the report referenced in C.3.5.

C.4 Summary.

C.4.1 It should be recognized that the critical radiant flux test method provides a useful way of ranking floor covering systems on the basis of this important fire property. However, critical radiant flux is only one of several parameters that determine the fire behavior of floor covering systems.

C.4.1.1 Critical radiant flux indicates the threshold above which flame spread occurs. To use this property in fire safety estimates, the probable heat flux exposure to the floor from the initiating fire needs to be judged. Such estimates must, for the present, depend on judgment or on data from prototype experiments.

C.4.1.2 Once a fire is initiated in a corridor, other parameters such as critical radiant flux for ignition and rate of flame spread, as well as corridor configuration and the presence of combustibles such as ceiling and wall linings, can be important in determining the ultimate spread of fire.

C.4.2 Because many parameters are involved in determining fire behavior, establishment of criteria for critical radiant flux of floor covering systems can be expected to reduce, but not to eliminate, the incidence of extensive flame spread of floor covering systems.

C.4.3 In this procedure, the specimens are subjected to one or more specific sets of laboratory fire test exposure conditions. If different test conditions are substituted or the anticipated end-use conditions are changed, it might not be possible to predict

changes in the performance characteristics measured by using this test. Therefore, the results are valid only for the fire test exposure conditions described in this procedure.

C.4.4 If the test results obtained by this standard are to be considered in the total assessment of the fire hazard, then all the pertinent established criteria for the fire hazard assessment are to be included in the consideration.

C.5 References.

- (1) Fung, F. C. W., Suchomel, M. R., and Oglesby, P. L. "The NBS Program on Corridor Fires." *Fire Journal*, Vol. 61, No. 3 (1973), pp. 41–48.
- (2) Quintere, J., and Huggett, C. "An Evaluation of Flame Spread Test Methods for Floor Covering Materials." National Bureau of Standards Special Publication 411. Washington, DC: U.S. Government Publishing Office, November 1974, pp. 59–89.
- (3) Benjamin, I., and Adams, H. "The Flooring Radiant Panel Test and Proposed Criteria." *Fire Journal*, Vol. 70, No. 2, March 1976.
- (4) Quintere, J. "The Application and Interpretation of a Test Method to Determine the Hazard of Floor Covering Fire Spread in Building Corridors." International Symposium on Fire Safety of Combustible Materials, University of Edinburgh, October 1975.
- (5) Hartzel, L. G. "Development of a Radiant Panel Test for Flooring Materials." NBSIR 74-495. Gaithersburg, MD: National Bureau of Standards, May 1974.
- (6) Tu, K-M, and Davis, S. "Flame Spread of Carpet Systems Involved in Room Fires." NBSIR 76-1013. Gaithersburg, MD: National Bureau of Standards, June 1976.
- (7) Davis, S., Lawson, J. R., and Parker, W. J. "Examination of the Variability of the ASTM E648 Standard with Respect to Carpets." NISTIR 89-4191. Gaithersburg, MD: National Institute of Standards and Technology, October 1989.

Annex D Precision and Bias

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

D.1 Introduction. This statement is based on the results of two factorially designed experiments performed by 13 laboratories in which a total of 18 floor covering systems were tested.

D.2 Test Results. Defining a test result as the average of three replicate determinations, the repeatability (within laboratory variability) was about 20 percent of the measured value, and the reproducibility (among laboratory variability) was about 35 percent of the measured value. Based on changes that have been made in this standard, a new precision and bias statement is being prepared.

D.2.1 Repeatability is a quantity that is exceeded only about 5 percent of the time by the difference, taken in absolute value, of two randomly selected results obtained by the same laboratory on a given material. (See Mandel, "Repeatability and Reproducibility.")

D.2.2 Reproducibility is exceeded only about 5 percent of the time by the difference, taken in absolute value, of two single test results made on the same material by two randomly selected laboratories.

Annex E Safety Precautions

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

E.1 Gas-Air Fuel Explosions. The possibility of a gas-air fuel explosion in the test chamber should be recognized.

E.1.1 Safeguards should be installed in the panel fuel supply system.

E.1.2 Safeguards should include one or more of the following:

- (1) Gas feed cutoff that is activated when the air supply fails
- (2) Fire sensor directed at the panel surface that stops fuel flow when the panel flame goes out
- (3) Commercial gas water heater or gas-fired furnace pilot burner control thermostatic shutoff that is activated when the gas supply fails

E.1.3 Safeguards should be arranged for a manual reset.

E.2 Exhaust System. The exhaust system should be designed and operated so that the laboratory environment is protected from smoke and gas.

E.2.1 Operator exposure to combustion products should be minimized.

E.2.2 The operator should ensure that the exhaust system is working properly and should wear appropriate clothing, including gloves.

Annex F Informational References

F.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

F.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 101®, *Life Safety Code*®, 2021 edition.

NFPA 5000®, *Building Construction and Safety Code*®, 2021 edition.

F.1.2 Other Publications.

F.1.2.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E648, *Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source*, 2019a¹.

F.1.2.2 ISO Publications. International Organization for Standardization, ISO Central Secretariat, BIBC II, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland.

ISO/IEC 17011, *Conformity assessment — Requirements for accreditation bodies accrediting conformity assessment bodies*, 2017.

ISO/IEC 17025, *General requirements for the competence of testing and calibration laboratories*, 2017.

F.1.2.3 Other Publications.

Benjamin, I., and Adams, H. "The Flooring Radiant Panel Test and Proposed Criteria." *Fire Journal*, Vol. 70, No. 2, March 1976.

Davis, S., Lawson, J. R., and Parker, W. J. "Examination of the Variability of the ASTM E648 Standard with Respect to Carpets." NISTIR 89-4191. Gaithersburg, MD: National Institute of Standards and Technology, October 1989.

Fung, F. C. W., Suchomel, M. R., and Oglesby, P. L. "The NBS Program on Corridor Fires." *Fire Journal*, Vol. 61, No. 3 (1973), pp. 41-48.

Hartzel, L. G. "Development of a Radiant Panel Test for Flooring Materials." NBSIR 74-495. Gaithersburg, MD: National Bureau of Standards, May 1974.

Mandel, J., "Repeatability and Reproducibility." *Materials Research and Standards*, MTRSA, Vol. 11, No. 8, p. 8.

Quintere, J. and Huggett, C. "An Evaluation of Flame Spread Test Methods for Floor Covering Materials." National Bureau of Standards Special Publication 411. Washington, DC: U.S. Government Publishing Office, November 1974, pp. 59-89.

Quintere, J. "The Application and Interpretation of a Test Method to Determine the Hazard of Floor Covering Fire Spread in Building Corridors." International Symposium on Fire Safety of Combustible Materials, University of Edinburgh, October 1975.

Tu, K-M, and Davis, S. "Flame Spread of Carpet Systems Involved in Room Fires." NBSIR 76-1013. Gaithersburg, MD: National Bureau of Standards, June 1976.

F.2 Informational References. (Reserved)**F.3 References for Extracts in Informational Sections. (Reserved)**

Index

Copyright © 2022 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

- A-
 - Administration, Chap. 1**
 - Application, 1.3
 - Purpose, 1.2
 - Scope, 1.1
 - Summary of Test Method, 1.4
 - Approved**
 - Definition, 3.2.1, A.3.2.1
- B-
 - Blackbody Temperature**
 - Definition, 3.3.1
- C-
 - Calculations, Chap. 8**
 - Formulas, 8.2
 - General, 8.1
 - Commentary on Critical Radiant Flux Test, Annex C**
 - Experimental Studies of Relevance, C.3
 - Introduction, C.1
 - Nature of the Test, C.2
 - References, C.5
 - Summary, C.4
 - Critical Radiant Flux**
 - Definition, 3.3.2
- D-
 - Definitions, Chap. 3**
- E-
 - Explanatory Material, Annex A**
- F-
 - Flameout**
 - Definition, 3.3.3, A.3.3.3
 - Floor Covering**
 - Definition, 3.3.4
 - Floor Covering System**
 - Definition, 3.3.5
 - Flooring**
 - Definition, 3.3.6
 - Flux Profile**
 - Definition, 3.3.7
- I-
 - Informational References, Annex F**
- P-
 - Precision and Bias, Annex D**
 - Introduction, D.1
- Test Results, D.2
 - R-
 - Radiant Heat Energy Flux Profile Standardization, Chap. 6**
 - Calibration of Radiation Instrumentation, 6.2
 - Potentiometer, 6.2.3
 - Radiation Pyrometer, 6.2.1
 - Total Heat Flux Meter, 6.2.2
 - Procedure, 6.1
 - Referenced Publications, Chap. 2**
 - Report, Chap. 9**
 - Required Information, 9.1
 - S-
 - Safety Precautions, Annex E**
 - Exhaust System, E.2
 - Gas-Air Fuel Explosions, E.1
 - Sample Data Logs, Annex B**
 - Data Logs, B.1
 - Shall**
 - Definition, 3.2.2
 - Should**
 - Definition, 3.2.3
 - Standard**
 - Definition, 3.2.4
 - Standard Simulated Concrete Subfloor**
 - Definition, 3.3.8
 - T-
 - Test Apparatus, Chap. 4**
 - Dummy Specimen, 4.8
 - Exhaust Hood, 4.7, A.4.7
 - Pilot Burner, 4.5
 - Radiant Heat Energy Source, 4.3
 - Radiant Panel Test Apparatus, 4.1
 - Specimen Holder, 4.4, A.4.4
 - Test Chamber, 4.2
 - Thermocouples, 4.6
 - Timer, 4.9
 - Test Procedure, Chap. 7**
 - Completion of Test, 7.5
 - Data Collection and Recording, 7.6
 - Extent of Flame Travel After a Prescribed Period, 7.9
 - Flame Propagation of Specimen, 7.4
 - Ignition of Pilot Burner, 7.3
 - Pretest Heating, 7.1
 - Removal of Specimen, 7.7
 - Sample Mounting, 7.2
 - Subsequent Testing, 7.8
- Test Specimens, Chap. 5**

Sampling Procedure, 5.1

Specimen Conditioning, 5.3

Specimen Size and Mounting, 5.2, A.5.2

Carpet, 5.2.4

Other Carpet, 5.2.4.3

Simulated Carpet and Cushion Pad Over
Concrete, 5.2.4.1

Simulated Carpet With or Without Integral Cushion Pad
Bonded to Concrete, 5.2.4.2

Hardwood Flooring, 5.2.9

Laminate Flooring, 5.2.8

Number of Specimens, 5.2.10

Planks, Tiles, Cove, or Base, 5.2.6

Resilient Flooring, 5.2.7, A.5.2.7

Standard Simulated Concrete Floor, 5.2.3

Tiles, 5.2.5

Total Flux Meter

Definition, 3.3.9



Sequence of Events for the Standards Development Process

Once the current edition is published, a Standard is opened for Public Input.

Step 1 – Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Technical Committee holds First Draft Meeting to revise Standard (23 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Technical Committee ballots on First Draft (12 weeks); Technical Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted on the document information page

Step 2 – Comment Stage

- Public Comments accepted on First Draft (10 weeks) following posting of First Draft Report
- If Standard does not receive Public Comments and the Technical Committee chooses not to hold a Second Draft meeting, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance (see Step 4) or
- Technical Committee holds Second Draft Meeting (21 weeks); Technical Committee(s) with Correlating Committee (7 weeks)
- Technical Committee ballots on Second Draft (11 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee Second Draft Meeting (9 weeks)
- Correlating Committee ballots on Second Draft (8 weeks)
- Second Draft Report posted on the document information page

Step 3 – NFPA Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks) following the posting of Second Draft Report
- NITMAMs are reviewed and valid motions are certified by the Motions Committee for presentation at the NFPA Technical Meeting
- NFPA membership meets each June at the NFPA Technical Meeting to act on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the NFPA Technical Meeting

Step 4 – Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Technical Meeting action must be filed within 20 days of the NFPA Technical Meeting
- Standards Council decides, based on all evidence, whether to issue the standard or to take other action

Notes:

1. Time periods are approximate; refer to published schedules for actual dates.
2. Annual revision cycle documents with certified amending motions take approximately 101 weeks to complete.
3. Fall revision cycle documents receiving certified amending motions take approximately 141 weeks to complete.

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment Through the Online Submission System

Following publication of the current edition of an NFPA standard, the development of the next edition begins and the standard is open for Public Input.

Submit a Public Input

NFPA accepts Public Input on documents through our online submission system at www.nfpa.org. To use the online submission system:








- Choose a document from the List of NFPA codes & standards or filter by Development Stage for “codes accepting public input.”
- Once you are on the document page, select the “Next Edition” tab.
- Choose the link “The next edition of this standard is now open for Public Input.” You will be asked to sign in or create a free online account with NFPA before using this system.
- Follow the online instructions to submit your Public Input (see www.nfpa.org/publicinput for detailed instructions).
- Once a Public Input is saved or submitted in the system, it can be located on the “My Profile” page by selecting the “My Public Inputs/Comments/NITMAMs” section.

Submit a Public Comment

Once the First Draft Report becomes available there is a Public Comment period. Any objections or further related changes to the content of the First Draft must be submitted at the Comment Stage. To submit a Public Comment follow the same steps as previously explained for the submission of Public Input.

Other Resources Available on the Document Information Pages

Header: View document title and scope, access to our codes and standards or NFCSS subscription, and sign up to receive email alerts.

 Current & Prior Editions	Research current and previous edition information.
 Next Edition	Follow the committee's progress in the processing of a standard in its next revision cycle.
 Technical Committee	View current committee rosters or apply to a committee.
 Ask a Technical Question	For members, officials, and AHJs to submit standards questions to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA standards relevant to your work.
 News	Provides links to available articles and research and statistical reports related to our standards.
 Purchase Products & Training	Discover and purchase the latest products and training.
 Related Products	View related publications, training, and other resources available for purchase.

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the NFPA *Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include NFPA *Bylaws*, NFPA *Technical Meeting Convention Rules*, NFPA *Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the NFPA *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA headquarters; all these documents are also available on the NFPA website at “www.nfpa.org/regs.”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at Section 1.4.)

III. Step 1: First Draft Report. The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3.) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b).]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.4.) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the NFPA Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b).]

V. Step 3a: Action at NFPA Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion (NITMAM). (See *Regs* at 4.5.2.) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June NFPA Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an NFPA Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no NITMAM is received and certified in accordance with the *Technical Meeting Convention Rules*, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5.)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the NFPA or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (see *Regs* at Section 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an NFPA Technical Meeting within 75 days from the date of the recommendation from the NFPA Technical Meeting, unless this period is extended by the Council (see *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (see *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the NFPA. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in Section 1.7 of the *Regs*.

X. For More Information. The program for the NFPA Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. To view the First Draft Report and Second Draft Report as well as information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/docinfo) or contact NFPA Codes & Standards Administration at (617) 984-7246.



CODES AND STANDARDS GO DIGITAL. AND GO ANYWHERE.

**TRY NFPA LiNK® FREE FOR 14 DAYS
AND GET DIGITAL ACCESS TO
CODES AND STANDARDS.**

Discover NFPA LiNK. It's dynamic digital access to codes and standards, right at your fingertips. Search, share, and find solutions on the job, faster and more efficiently. Now you can get your first two weeks free with a hassle-free trial, at no cost and no credit card required. If NFPA LiNK is right for you, subscriptions start as low as \$9.99/month. Experience the power of NFPA LiNK for yourself.

Learn more and activate your risk-free trial for 14 days free at nfpa.org/LiNK

