

NFPA[®]

276

Standard Method of
Fire Test for Determining the
Heat Release Rate of Roofing
Assemblies with Combustible
Above-Deck Roofing Components

2023



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.



REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2022 National Fire Protection Association®. All Rights Reserved.

NFPA® 276

Standard Method of

Fire Test for Determining the Heat Release Rate of Roofing Assemblies with Combustible Above-Deck Roofing Components

2023 Edition

This edition of NFPA 276, *Standard Method of Fire Test for Determining the Heat Release Rate of Roofing Assemblies with Combustible Above-Deck Roofing Components*, was prepared by the Technical Committee on Fire Tests. It was issued by the Standards Council on April 28, 2022, with an effective date of May 18, 2022, and supersedes all previous editions.

This edition of NFPA 276 was approved as an American National Standard on May 18, 2022.

Origin and Development of NFPA 276

Fires involving roof deck assemblies have resulted in significant losses and damage to buildings and structures that otherwise had fire protection systems, construction features, or both in place to minimize the spread of fire. Perhaps the most famous of those fires is the 1953 fire at the General Motors Corporation facility in Livonia, MI. Analysis of that fire indicated that, while the exterior roof surface might have been able to minimize the propagation of fire, the interior portions of the roof decking that included combustible materials installed on the deck allowed the fire to spread along the interior underside of the roof deck assembly.

Although insurance company interests developed some test protocols to address the spread of fire along the underside of steel roof decks, no national test or evaluation standard had been devised to address this potential concern until 2006, when NFPA 276 was proposed. The fire performance of the roof assembly is evaluated by measuring the heat release rate below the roof deck where the assembly incorporates combustible construction components, a common construction technique.

The protocol includes a fire exposure test and an evaluation test with an auxiliary fuel package. To properly characterize the performance of the roof assembly, NFPA 276 specifies the requisite provisions for the furnace construction and configuration; instrumentation needs; size, attributes, and conditioning of the test sample; calibration of the furnace; procedure for running the tests; and the reporting requirements to describe the test results.

NFPA 276 can be referenced in model building codes, state or local regulations, and private sector loss prevention policies to allow for a full and complete evaluation of these common roofing assemblies.

There were no substantive changes in the 2015, 2019, or 2023 editions.

Technical Committee on Fire Tests

Barry L. Badders, Jr., *Chair*
Intertek Testing Services, TX [RT]

Hubert Biteau, S E-A, Ltd., CO [SE]
Benjamin H. Caldwell, Skidmore, Owings & Merrill LLP (SOM), NY [SE]
Karen C. Carpenter, Southwest Research Institute, TX [RT]
Rick D. Davis, National Institute of Standards & Technology (NIST), MD [RT]
Scott E. Dillon, Crane Engineering, MN [SE]
William E. Fitch, Phyrefish.com, FL [SE]
Richard G. Gann, Gaithersburg, MD [SE]
Marcelo M. Hirschler, GBH International, CA [SE]
Paul A. Hough, Armstrong World Industries, Inc., PA [M]
William E. Koffel, Koffel Associates, Inc., MD [SE]
Sergei V. Levchik, Israel Chemicals Ltd. (ICL-IP), NY [M]
Rep. ACC-North American Flame Retardant Alliance
Michael E. Luna, ICC NTA, LLC, TX [RT]
James Andrew Lynch, The Fire Solutions Group, PA [SE]
John Martell, Professional Fire Fighters of Maine/IAFF, ME [L]
Rep. International Association of Fire Fighters

Rodney A. McPhee, Canadian Wood Council, Canada [M]
Kathleen A. Newman, Firetect, CA [M]
Nicholas Ozog, Wiss, Janney, Elstner Associates, Inc., IL [SE]
Arthur J. Parker, JENSEN HUGHES, MD [SE]
Bill Perdue, American Home Furnishings Alliance (AHFA), NC [U]
Shamim Rashid-Sumar, National Ready Mixed Concrete Assn., NY [M]
Michael L. Savage, Sr., Marion County Building Safety, FL [E]
Michael Schmeida, Gypsum Association, OH [M]
David T. Sheppard, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
Dwayne Sloan, UL LLC, NC [RT]
Kuma Sumathipala, American Wood Council, VA [M]
Robert J. Wills, American Iron and Steel Institute, AL [M]
Dong Zeng, FM Global, MA [I]
Rep. FM Global

Alternates

Marc Alam, Canadian Wood Council, Canada [M]
(Alt. to Rodney A. McPhee)
Richard J. Davis, FM Global, MA [I]
(Alt. to Dong Zeng)
Timothy Earl, GBH International, MI [SE]
(Alt. to Marcelo M. Hirschler)
Stephen Paul Fuss, US Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]
(Alt. to David T. Sheppard)
Justin A. Geiman, Fire and Risk Alliance LLC, MD [SE]
(Alt. to James Andrew Lynch)
Karl Dana Houser, Intertek, PA [RT]
(Alt. to Barry L. Badders, Jr.)
Jonathan Humble, American Iron and Steel Institute, CT [M]
(Alt. to Robert J. Wills)

Marc L. Janssens, Southwest Research Institute, TX [RT]
(Alt. to Karen C. Carpenter)
Elizabeth C. Keller, Engineering Systems, Inc., NC [SE]
(Alt. to Scott E. Dillon)
Cori Leffler, Firetect, CA [M]
(Alt. to Kathleen A. Newman)
Daniel A. Martin, JENSEN HUGHES, MD [SE]
(Alt. to Arthur J. Parker)
Jason V. Smart, American Wood Council (AWC), VA [M]
(Alt. to Kuma Sumathipala)
Matthew T. Vinci, International Association of Fire Fighters, DC [L]
(Alt. to John Martell)
Luke C. Woods, UL LLC, MA [RT]
(Alt. to Dwayne Sloan)

Nonvoting

Rohit “Rik” Khanna, US Consumer Product Safety Commission (CPSC), MD [C]
Rep. US Consumer Product Safety Commission

Andrew Lock, US Consumer Product Safety Commission, MD [C]
Rep. US Consumer Product Safety Commission

Tracy L. Vecchiarelli, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA, for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members, and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

| | | | |
|--|-------|---|--------|
| Chapter 1 Administration | 276-4 | 7.2 Calibration Using Calibration Specimen. | 276-8 |
| 1.1 Scope. | 276-4 | 7.3 Preheating. | 276-8 |
| 1.2 Purpose. | 276-4 | 7.4 Blank Specimen Test Procedure. | 276-8 |
| 1.3 Application. | 276-4 | 7.5 Calibration Test Procedure. | 276-8 |
| Chapter 2 Referenced Publications | 276-4 | Chapter 8 Conduct of Tests | 276-10 |
| 2.1 General. | 276-4 | 8.1 Calibration Using Calibration Test Specimen. .. | 276-10 |
| 2.2 NFPA Publications. (Reserved) | 276-4 | 8.2 Verification Using Blank Specimen. | 276-10 |
| 2.3 Other Publications. | 276-4 | 8.3 Testing. | 276-10 |
| 2.4 References for Extracts in Mandatory Sections. (Reserved) | 276-5 | 8.4 Acceptance Criteria. | 276-10 |
| Chapter 3 Definitions | 276-5 | Chapter 9 Report | 276-10 |
| 3.1 General. | 276-5 | 9.1 Data and Information. | 276-10 |
| 3.2 NFPA Official Definitions. | 276-5 | 9.2 Calibration Information. | 276-10 |
| 3.3 General Definitions. | 276-5 | 9.3 Test Specimen Materials. | 276-10 |
| Chapter 4 Test Furnace | 276-5 | 9.4 Main Burner Fuel Flow. | 276-10 |
| 4.1 Furnace Construction. | 276-5 | 9.5 Flue Gas Temperatures. | 276-10 |
| 4.2 Burner Fuels and Supply Air. | 276-6 | 9.6 Auxiliary Burner Fuel Flow. | 276-10 |
| Chapter 5 Instrumentation | 276-6 | 9.7 Heat Release Rate. | 276-10 |
| 5.1 Thermocouples. | 276-6 | 9.8 Visual Observations. | 276-10 |
| 5.2 Pressure Measurement. | 276-6 | 9.9 Internal Component Description. | 276-10 |
| Chapter 6 Test Specimens and Conditioning | 276-6 | 9.10 Discussion of Performance. | 276-10 |
| 6.1 Blank Test Specimen. | 276-6 | Annex A Explanatory Material | 276-10 |
| 6.2 Calibration Specimen. | 276-6 | Annex B Informational References | 276-11 |
| 6.3 Test Specimen. | 276-7 | Index | 276-13 |
| 6.4 Conditioning. | 276-7 | | |
| Chapter 7 Furnace Verification and Calibration | 276-8 | | |
| 7.1 Verification of Operation Using Blank Test Specimen. | 276-8 | | |

NFPA 276

Standard Method of

Fire Test for Determining the Heat Release Rate of Roofing Assemblies with Combustible Above-Deck Roofing Components

2023 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the "List of NFPA Codes & Standards" at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope.

1.1.1* This standard describes a method for determining the heat release rate from below the deck of roofing assemblies that have combustible above-deck roofing components when the assemblies are exposed to a fire from below the roof deck.

1.1.2 The performance of the above-deck roofing assembly is evaluated by determining the heat release rate below the deck of the roof test specimen.

1.1.3* This test method is based on the substitution method for measuring the heat release rate by using an auxiliary fuel (propane) to provide the surrogate heat release rate.

1.2 Purpose.

1.2.1* Test Method.

1.2.1.1 Two fire tests are conducted to determine the heat release rate of the test specimen as follows:

- (1) Fire exposure test
- (2) Evaluation test with auxiliary fuel

1.2.1.2 Each fire test is 30 minutes in duration.

1.2.2 Fire Exposure Test.

1.2.2.1 The fire exposure test consists of developing a flue time-temperature curve based on the combined burning of the test specimen and the fire exposure.

1.2.2.2 The fire exposure is produced by heptane-fired burners (main burners), which subject the underside of the roof deck assembly to a predetermined exposure condition.

1.2.3 Evaluation Test.

1.2.3.1* The evaluation test determines the contribution of the test specimen by introducing an auxiliary fuel (propane) through evaluating burners in addition to the heptane-fired main burners.

1.2.3.2 The same time-temperature curve as in the fire exposure test is recreated with a noncombustible (blank) specimen in place.

1.3 Application.

1.3.1 This method of fire test determines the heat release rate of the test specimen during the 30-minute fire test.

1.3.2 This method of fire test determines the heat release rate of the test specimen when subjected to a specified fire exposure condition.

1.3.3 This standard does not address all safety problems or considerations associated with its use.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. (Reserved)

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM C62, *Standard Specification for Building Brick (Solid Masonry Units Made From Clay or Shale)*, 2017.

ASTM C208, *Standard Specification for Cellulosic Fiber Insulating Board*, 2012 (2017) e2.

ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*, 2019a.

2.3.2 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections. (Reserved)

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1 Shall. Indicates a mandatory requirement.

3.2.2 Should. Indicates a recommendation or that which is advised but not required.

3.2.3 Standard. An NFPA standard, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA manuals of style. When used in a generic sense, such as in the phrases "standards development process" or "standards development activities," the term "standards" includes all NFPA standards, including codes, standards, recommended practices, and guides.

3.3 General Definitions.

3.3.1* Blank Test Specimen. A noncombustible test specimen placed on the furnace opening when the evaluation test is conducted.

3.3.2 Calibration Specimen. A test specimen constructed of known materials that will produce specific heat release rates.

Chapter 4 Test Furnace

4.1 Furnace Construction.

4.1.1* The fire test apparatus shall consist of a furnace, an opening for mounting the test specimen, a method for providing supply air, fire exposure burners, auxiliary propane burners, and data acquisition equipment.

4.1.2* The fire test furnace shall be a rectangular, horizontal chamber with a removable lid, having inside dimensions of 60 in. \pm 1/8 in. (1524 mm \pm 3 mm) wide, 210 in. \pm 1/2 in. (5300 mm \pm 3 mm) long, and 45 in. \pm 1/8 in. (1143 mm \pm 3 mm) deep.

4.1.3 The interior sides shall be lined with refractory firebrick or equivalent, having dimensions of 4 1/2 in. \pm 1/8 in. (114 mm \pm 3 mm) wide, 9 in. \pm 1/8 in. (229 mm \pm 3 mm) long, and 2 1/2 in. \pm 1/8 in. (64 mm \pm 3 mm) deep and the following properties:

- (1) Maximum recommended temperature: 2800°F (1538°C)
- (2) Bulk density: 55 lb/ft³ \pm 3 lb/ft³ (880 kg/m³ \pm 48 kg/m³)

(3) Thermal conductivity in accordance with Table 4.1.3

4.1.4 The exterior sides and top edges of the furnace shall be constructed using clay brick, Grade NW or greater, per ASTM C62, *Standard Specification for Building Brick (Solid Masonry Units Made From Clay or Shale)*.

4.1.5 A gap of 1 1/4 in. (32 mm) shall be maintained between the refractory firebrick and the standard brick on the four walls of the furnace.

4.1.6 The floor of the furnace shall consist of a minimum 3 in. (76 mm) thick layer of sand.

4.1.7 A baffle having dimensions of 16 in. \pm 1/8 in. (406 mm \pm 6 mm) high, 48 in. \pm 1/8 in. (1219 mm \pm 6 mm) wide, and 2 1/2 in. \pm 1/8 in. (64 mm \pm 6 mm) thick shall be located on the floor of the test furnace 12 in. \pm 1/8 in. (305 mm \pm 3 mm) from the exposure (front) end of the test furnace and shall be constructed of wire-reinforced castable refractory material with physical properties as follows:

- (1) Maximum recommended temperature: 1200°F (650°C)
- (2) Bulk density: 120 lb/ft³ \pm 6 lb/ft³ (1920 kg/m³ \pm 96 kg/m³)
- (3) Thermal conductivity at 300°F to 700°F (149°C to 371°C) of 0.50 Btu-in./hr-ft²·°F to 0.71 Btu-in./hr-ft²·°F (0.072 W/m·°C to 0.102 W/m·°C)

4.1.8 The top of the furnace shall be constructed of a minimum 3 1/2 in. (90 mm) thick castable refractory material having physical properties as specified in 4.1.7.

4.1.8.1 A 48 in. \pm 1/8 in. \times 48 in. \pm 1/8 in. (1219 mm \pm 3 mm \times 1219 mm \pm 3 mm) opening shall be provided in the top of the furnace.

4.1.8.2 The front edge of the opening shall be located 48 in. \pm 1/8 in. (1219 mm \pm 3 mm) from the interior surface of the wall containing the main burners.

4.1.9 The opening into the test furnace shall be framed to keep the installed test specimen stationary.

4.1.9.1 The inside dimensions of the framed area shall be 63 1/2 in. \pm 1/8 in. (1613 mm \pm 3 mm) long and 57 1/2 in. \pm 1/8 in. (1461 mm \pm 3 mm) wide.

4.1.9.2 A minimum 1 1/2 in. (38 mm) lip shall be provided to support the test specimen.

4.1.10 A removable cover shall be constructed of the same castable refractory material as the top of the furnace and shall have the same thickness as the top of the furnace.

4.1.11* The main burners shall be spray nozzles with a 60-degree spray cone and shall be capable of providing a fuel flow rate of 4 1/2 gal/hr \pm 1/4 gal/hr (17 L/hr \pm 1 L/hr).

Table 4.1.3 Insulating Brick Thermal Conductivity

| Mean Temperature | | Thermal Conductivity | |
|------------------|------|--------------------------------|--------|
| °F | °C | Btu-in./hr-ft ² ·°F | W/m·°C |
| 500 | 260 | 2.3 | 0.33 |
| 1000 | 538 | 2.4 | 0.34 |
| 1500 | 815 | 2.6 | 0.37 |
| 2000 | 1093 | 2.7 | 0.39 |

4.1.12 The auxiliary burners shall be venturi, high pressure nozzle, air-aspirating burners with the following properties:

- (1) Operating range: Gauge pressure ≤ 15 psi (103 kPa)
- (2) Rating: 360,000 Btu/hr (105 kW) at 5 psi (35 kPa) and 800,000 Btu/hr (234 kW) at 25 psi (172 kPa)
- (3) Nozzle orifice outside diameter: $4\frac{1}{8}$ in. (105 mm) nominal

4.1.13 A 16 in. $\pm \frac{1}{8}$ in. (405 mm ± 3 mm) diameter flue shall be located on the side of the test furnace opposite the main burners.

4.1.14* The flue shall be covered with insulation that provides an R-value of 30 ft²·°F·h/Btu (5.3 K·m²/W).

4.1.15 Airflow twisting baffles shall be located in the flue, positioned within the plane of the wall.

4.2 Burner Fuels and Supply Air.

4.2.1 The main burners shall burn liquid n-heptane.

4.2.2 The heptane fuel shall be supplied to the main burners using a delivery system consisting of the following:

- (1) Supply tank
- (2) Shutoff valve
- (3) Filter
- (4) Pump
- (5) Pressure gauge
- (6) Bleeder valve
- (7) Flow controller and control valve
- (8) Solenoid valve
- (9) Control valves for each of the three main burners

4.2.3 The auxiliary burners shall burn propane with a known heat of combustion.

4.2.4 Propane fuel shall be supplied to the auxiliary burners through a delivery system consisting of the following:

- (1) Supply tank
- (2) Pressure regulator
- (3) Gas temperature thermocouple
- (4) Flow controller and control valve
- (5) Gas solenoid valves

4.2.5 Supply air shall be supplied to the main burners through a blower.

4.2.6 The supply air shall be preheated to 100°F ± 5 °F (38°C ± 3 °C) prior to injection into the burners.

4.2.7 The flow rates of the air and the heptane shall be controlled such that the fire exposure rate to the specimen is 1650 Btu/ft²/min ± 60 Btu/ft²/min (312 kW/m² ± 11 kW/m²).

Chapter 5 Instrumentation

5.1 Thermocouples. Insulated, ungrounded, Inconel-sheathed, type K (Chromel–Alumel) thermocouples, with wires 0.012 in. ± 0.002 in. (0.3 mm ± 0.05 mm) in diameter, shall be used at each required location.

5.1.1 Twelve thermocouples shall be located inside the flue to measure the exhaust gas temperatures and arranged as shown in Figure 5.1.1.

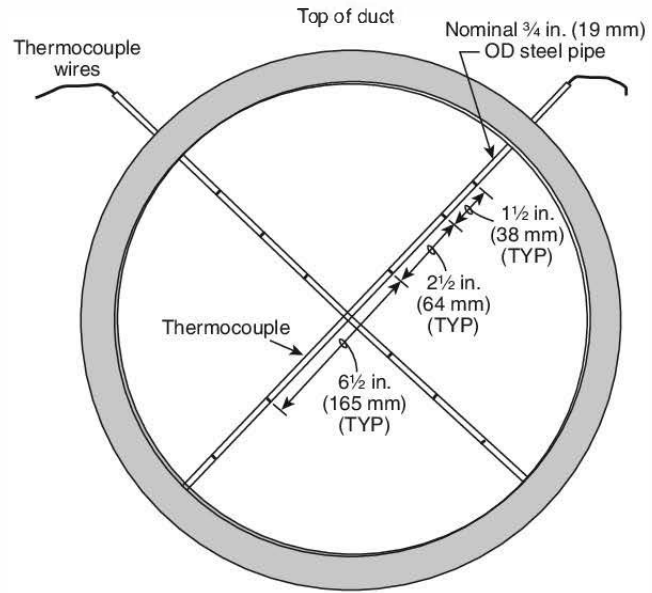


FIGURE 5.1.1 Flue Thermocouple Layout.

5.1.2 The thermocouple array shall be positioned such that the array is placed in the flue at a distance of 64 in. ± 1 in. (1626 mm ± 25 mm) from the fire-exposed face of the fire-brick.

5.1.3 The thermocouples in the array shall face toward the airflow.

5.1.4 Two 18 AWG (1.02 mm) thermocouples embedded $\frac{1}{8}$ in. (3.1 mm) into the furnace apparatus wall surface shall be mounted in refractory cement, which has been dried to avoid cracking.

5.1.5 The thermocouples required by 5.1.4 shall be placed in the two side walls of the furnace apparatus such that they are centered side to side and top to bottom.

5.2 Pressure Measurement.

5.2.1 The pressure inside the test furnace shall be monitored using one of two pressure probes.

5.2.2 The pressure probe shall be located 3 in. $\pm \frac{1}{4}$ in. (76 mm ± 6 mm) below the exposed surface of the test specimen.

Chapter 6 Test Specimens and Conditioning

6.1 Blank Test Specimen.

6.1.1 A blank test specimen shall be constructed using noncombustible refractory concrete.

6.1.2 The blank test specimen shall be 61 in. $\pm \frac{1}{8}$ in. (1549 mm ± 3 mm) long, 55 1/2 in. $\pm \frac{1}{8}$ in. (1410 mm ± 3 mm) wide, and 3 1/2 in. $\pm \frac{1}{8}$ in. (90 mm ± 3 mm) thick.

6.2 Calibration Specimen.

6.2.1 The calibration specimen shall consist of wood fiber insulation placed on a steel deck and covered with a steel cover.

6.2.2 The specimen shall be 61 in. $\pm \frac{1}{8}$ in. (1549 mm ± 3 mm) long and 55 1/2 in. $\pm \frac{1}{8}$ in. (1410 mm ± 3 mm) wide.

6.2.3 The steel deck shall be constructed of a primed steel deck measuring 59 ½ in. ± ½ in. (1511 mm ± 13 mm) long, 30 in. ± ½ in. (762 mm ± 13 mm) wide, and 18 gauge, 0.05 in. (1.3 mm) thick.

6.2.4 The steel deck shall be constructed using two pieces of 18 gauge, 0.05 in. (1.3 mm) narrow rib, fluted steel deck, with the steel flutes parallel to the long dimension of the specimen.

6.2.4.1 One piece of steel deck shall contain four flutes.

6.2.4.2 The second piece of steel deck shall contain five flutes and be placed over the first piece of steel deck such that one flute overlaps.

6.2.5 The wood fiber insulation shall meet ASTM C208, *Standard Specification for Cellulosic Fiber Insulating Board, Type II, Grade 1 or 2*, and shall be 1 in. ± ⅛ in. (25 mm ± 3 mm) thick.

6.2.5.1 The wood fiber shall be conditioned in accordance with Section 6.4 prior to construction of the calibration specimen.

6.2.5.2 The wood fiber shall consist of a board 48 in. ± ¼ in. (1219 mm ± 6 mm) long and 48 in. ± ¼ in. (1219 mm ± 6 mm) wide cut into equal halves.

6.2.5.3 The wood fiberboard shall be weighed prior to cutting and the weight recorded.

6.2.5.4 The two boards shall be butted tight at the cutline, positioned in the center of the steel deck, and fastened to the steel deck with two fasteners per board. The fasteners shall be self-tapping screws with 3 in. (76 mm) diameter steel washers placed along the centerline of each board and separated by a minimum of 6 in. (152 mm).

6.2.5.5 The area between the wood fiberboard and the specimen edge shall not be filled and shall remain open.

6.2.6 The steel cover shall be fabricated from nominal 2 in. (51 mm) × 2 in. (51 mm) angles, sized to fit around the calibration specimen and a single piece of sheet steel that is 61 in. ± ⅛ in. (1549 mm ± 3 mm) long, 55½ in. ± ⅛ in. (1410 mm ± 3 mm) wide, and 25 gauge, 0.02 in. (0.5 mm) thick.

6.2.6.1 The nominal 2 in. (51 mm) × 2 in. (51 mm) angles shall be welded to form a frame that is 61 in. ± ⅛ in. (1549 mm ± 3 mm) long and 55½ in. ± ⅛ in. (1410 mm ± 3 mm) wide, with the angles turned in.

6.2.6.2 The sheet steel cover shall be placed inside the angle iron frame and spot welded to the frame.

6.2.6.3 The angle iron frame and sheet steel shall be inverted and placed over the sheet steel deck and wood fiber.

6.2.6.4 The completed steel cover shall be placed over the steel deck and wood fiber to form the completed calibration test specimen.

6.3 Test Specimen.

6.3.1 Components, workmanship, and construction of the test specimen shall be representative of the materials or assembly that the test is intended to examine.

6.3.2 Care shall be taken to ensure that each layer of the specimen (steel deck, insulation, cover boards, each ply, and top

sheets) is installed such that the joints between adjacent layers are staggered or oriented perpendicular to the layer below during construction of a test specimen.

6.3.3 The test specimen shall have dimensions of 54½ in. ± ½ in. (1385 mm ± 13 mm) wide and 60 in. ± ½ in. (1525 mm ± 13 mm) long and shall be oriented such that the long dimension of the specimen is parallel with the long dimension of the test furnace.

6.3.4 The steel deck shall be installed in two pieces with the flutes oriented parallel to the long dimension of the opening.

6.3.4.1 One piece of steel deck shall contain four flutes.

6.3.4.2 The second piece of steel deck shall contain five flutes and be placed over the first piece of steel deck such that one flute overlaps.

6.3.5 The first layer of insulation board shall be installed in four pieces where the insulation boards are 36 in. (914 mm) × 48 in. (1219 mm) pieces or larger.

6.3.5.1 The first piece of insulation board shall be 36 in. ± ⅛ in. (914 mm ± 3 mm) × 48 in. ± ⅛ in. (1219 mm ± 3 mm) and shall be located in the left front side of the assembly when the specimen is viewed from above, with the nominal 36 in. (914 mm) dimension perpendicular to the 54½ in. (1385 mm) dimension of the opening.

6.3.5.2 The second piece of insulation board shall be 24 in. ± ⅛ in. (610 mm ± 3 mm) × 48 in. ± ⅛ in. (1219 mm ± 3 mm) and shall be located in the right front side of the assembly when the specimen is viewed from above, with the 24 in. (610 mm) dimension perpendicular to the 54½ in. (1385 mm) dimension of the opening.

6.3.5.3 The third piece of insulation board shall be 6 in. ± ⅛ in. (152 mm ± 3 mm) × 48 in. ± ⅛ in. (1219 mm ± 3 mm) and shall be located in the right rear of the assembly when the specimen is viewed from above, with the 48 in. (1219 mm) dimension parallel to the 60 in. (1525 mm) dimension of the opening.

6.3.5.4 The fourth piece of insulation board shall be 6 in. ± ⅛ in. (152 mm ± 3 mm) × 12 in. ± ⅛ in. (305 mm ± 3 mm) and shall be located in the left rear of the assembly when the specimen is viewed from above, with the 12 in. (305 mm) dimension parallel to the 60 in. (1525 mm) dimension of the opening.

6.3.5.5 The edges of the insulation board pieces shall be permitted to be trimmed such that at all joints formed by the insulation the edges of the insulation pieces are in contact with each other.

6.4 Conditioning. All test specimens shall be conditioned in a room having a temperature of 73°F ± 5°F (23°C ± 3°C) and a relative humidity of 50 percent ± 5 percent.

6.4.1 The test specimen shall be placed in the conditioning room for curing for the manufacturer's specified time period, but no less than 24 hours and no more than 28 days.

6.4.2 The test specimens shall be tested within 30 minutes of removal from the conditioning room.

Chapter 7 Furnace Verification and Calibration

7.1 Verification of Operation Using Blank Test Specimen.

The operation of the furnace shall be verified using the blank test specimen within a maximum of 5 days prior to testing being conducted.

7.2 Calibration Using Calibration Specimen. The furnace shall be calibrated at a minimum of every 90 days using the calibration test specimen.

7.3 Preheating. The test furnace shall be preheated with the blank test specimen in place, and the main burner fuel flow shall be adjusted to the required flow.

7.3.1 The supply air shall be initiated, and the temperature of the supply air shall be $100^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($38^{\circ}\text{C} \pm 3^{\circ}\text{C}$).

7.3.2 The flow rate of heptane shall be constant to the main burners until the temperature inside the furnace is 300°F (149°C) as measured by the thermocouples embedded in the refractory brick as described in 5.1.4.

7.3.3 The fuel flow to the main burners shall be shut off when the preheat temperature is reached.

7.3.4 The supply air shall continue to operate.

7.3.5 The blank test specimen shall then be removed.

7.3.6 The next specimen shall not be placed into position for testing until the thermocouples embedded in the refractory brick as described in 5.1.4 indicate $170^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($77^{\circ}\text{C} \pm 3^{\circ}\text{C}$).

7.4 Blank Specimen Test Procedure. The verification of the operation of the test furnace shall be conducted for 40 minutes with the blank test specimen placed in the specimen opening.

7.4.1 The test furnace shall be preheated as described in Section 7.3.

7.4.2 The blank test specimen shall be placed in the sample opening of the test furnace.

7.4.3 The average temperatures measured by the 12 thermocouples located in the exhaust flue shall be recorded throughout the 40-minute test duration.

7.4.4 The temperatures shall be measured at intervals not exceeding 10 seconds during the test period.

7.4.5 Only the main burners shall be operated for the first 30 minutes of the test.

7.4.6 The supply air shall be provided at a temperature of $100^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($38^{\circ}\text{C} \pm 3^{\circ}\text{C}$).

7.4.7 Airflow into the main burners shall be $763 \text{ ft}^3/\text{min} \pm 76 \text{ ft}^3/\text{min}$ ($21.6 \text{ m}^3/\text{min} \pm 2.2 \text{ m}^3/\text{min}$).

7.4.8 The main burners shall be fired with the heptane supplied at a constant flow rate of $0.228 \text{ gal}/\text{min} \pm 0.002 \text{ gal}/\text{min}$ ($0.86 \text{ L}/\text{min} \pm 0.01 \text{ L}/\text{min}$) for the duration of the 40-minute test.

7.4.9 The airflow and the heptane pressure shall be permitted to be adjusted to achieve the required heptane flow rate.

7.4.10 The internal furnace pressure shall be maintained at $0.04 \text{ psi} \pm 0.01 \text{ psi}$ ($276 \text{ Pa} \pm 66 \text{ Pa}$) for the duration of the 40-minute test.

7.4.11 The average temperature within the test furnace after the 30-minute exposure using the main burners shall be $950^{\circ}\text{F} \pm 50^{\circ}\text{F}$ ($510^{\circ}\text{C} \pm 28^{\circ}\text{C}$) as measured by the 12 thermocouples described in 5.1.1.

7.4.12 The auxiliary propane burners shall be ignited after 30 minutes of testing.

7.4.13 The main burners and the auxiliary burners shall operate simultaneously during the last 10 minutes of the test.

7.4.14 The auxiliary burners shall be operated for a series of ten 1-minute periods, for a total auxiliary burner run time of 10 minutes.

7.4.15 The propane flow rate shall be adjusted for each time interval to achieve the target heat input shown in Table 7.4.15.

7.4.16 The average temperature within the test furnace after the 10-minute exposure using the main burners and the auxiliary burners shall be $1150^{\circ}\text{F} \pm 60^{\circ}\text{F}$ ($621^{\circ}\text{C} \pm 15^{\circ}\text{C}$) as measured by the 12 thermocouples described in 5.1.1.

7.4.17 The auxiliary propane burners shall be extinguished upon completion of the 40-minute test period, and then the heptane burners shall be extinguished.

7.4.18 Following the completion of the test with the blank test specimen and before additional tests are conducted, the blank test specimen shall be removed from the test furnace and the furnace allowed to cool to an internal temperature of $170^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($77^{\circ}\text{C} \pm 3^{\circ}\text{C}$), as indicated by the thermocouples embedded in the furnace walls.

7.4.19 The average temperature measured by the 12 thermocouples located in the exhaust flue shall be plotted as a function of time, resulting in the time-temperature curve produced during the duration of the test period.

7.4.20 The data derived from the blank test specimen shall be compared to previous blank test specimen data to verify proper operation of the test equipment.

7.4.21 Proper operation shall be verified if the integrated area under the time-temperature curve developed in accordance with 7.4.19 is within ± 10 percent of the previous blank specimen test.

7.5 Calibration Test Procedure. Calibration tests using the calibration test specimen shall be conducted at a period not to exceed 90 days, and the test shall be conducted in accordance with Section 7.5.

Table 7.4.15 Auxiliary Propane Burner Flow Rates

| Time Interval (min) | Target Heat Input | |
|------------------------|-------------------|---------------|
| | Btu/min | kW |
| 1 | 1763 ± 200 | 31 ± 3.5 |
| 2 | 2388 ± 200 | 42 ± 3.5 |
| 3 | 3014 ± 200 | 53 ± 3.5 |
| 4 | 3583 ± 200 | 63 ± 3.5 |
| 5 | 4208 ± 200 | 74 ± 3.5 |
| 6 | 4834 ± 200 | 85 ± 3.5 |
| 7 | 5459 ± 200 | 96 ± 3.5 |
| 8 | 6028 ± 200 | 106 ± 3.5 |
| 9 | 6654 ± 200 | 117 ± 3.5 |
| 10 | 7279 ± 200 | 128 ± 3.5 |

7.5.1 Verification Using Blank Specimen. A successful verification of operation shall have been conducted within the previous 5 days using the blank specimen in accordance with Section 7.4.

7.5.2 Fire Exposure Test Procedure. The calibration test specimen shall be exposed to the fire exposure test procedure.

7.5.2.1 The test furnace shall be preheated as described in Section 7.3.

7.5.2.2 The calibration test specimen described in Section 6.2 and conditioned in accordance with Section 6.4 shall be placed on the test furnace, over the furnace opening.

7.5.2.3 The test specimen-furnace interface shall be sealed with an insulating cement material to prevent heat loss from the test furnace chamber, with physical properties as follows:

- (1) Density: $\geq 22 \text{ lb/ft}^3$ (352 kg/m^3)
- (2) Recommended use temperature: $\leq 2000^\circ\text{F}$ (1093°C)
- (3) Noncombustible in accordance with ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*

7.5.2.4 The average temperatures measured by the 12 thermocouples located in the exhaust flue shall be recorded throughout the 30-minute test duration.

7.5.2.5 The temperatures shall be measured at intervals not exceeding 10 seconds during the test period.

7.5.2.6 The temperature of the supply air shall be $100^\circ\text{F} \pm 3^\circ\text{F}$ ($38^\circ\text{C} \pm 5^\circ\text{C}$).

7.5.2.7 The main burners shall be fired with the heptane supplied at a constant flow rate of $0.228 \text{ gal/min} \pm 0.002 \text{ gal/min}$ ($0.86 \text{ L/min} \pm 0.01 \text{ L/min}$) and shall provide a heat input to the furnace of $26,420 \text{ Btu/min} \pm 925 \text{ Btu/min}$ ($27,875 \text{ kJ/min} \pm 975 \text{ kJ/min}$).

7.5.2.8 The main burner heat input shall be held constant for the 30-minute test duration.

7.5.2.9 The heptane fuel flow to the main burners shall be secured 30 minutes after the initiation of the burners.

7.5.2.10 The supply air shall continue to run.

7.5.2.11 The calibration test specimen shall be removed.

7.5.2.12 The average temperature measured by the 12 thermocouples located in the exhaust flue shall be plotted as a function of time, resulting in the time-temperature curve produced during the test.

7.5.2.13 The furnace shall be allowed to cool until the thermocouples embedded in the furnace walls indicate $170^\circ\text{F} \pm 5^\circ\text{F}$ ($77^\circ\text{C} \pm 3^\circ\text{C}$), before additional tests are conducted.

7.5.3 Evaluation Test Procedure. The evaluation test shall be conducted using the blank test specimen.

7.5.3.1 The blank specimen shall be placed over the furnace opening, and all interfaces shall be sealed with a cementitious fireproofing material to prevent heat loss from the test furnace chamber.

7.5.3.2 The average temperatures measured by the 12 thermocouples located in the exhaust flue shall be recorded throughout the 30-minute test duration.

7.5.3.3 The temperatures shall be measured at intervals not exceeding 10 seconds during the test period.

7.5.3.4 The fuel flow rate of the auxiliary propane burners in gal/min (L/min) shall be recorded during the 30-minute test.

7.5.3.5 The fuel flow readings shall be recorded by the data acquisition system at intervals not exceeding 5 seconds.

7.5.3.6 The temperature of the supply air shall be $100^\circ\text{F} \pm 3^\circ\text{F}$ ($38^\circ\text{C} \pm 5^\circ\text{C}$).

7.5.3.7 The main burners shall be initiated as specified in 7.5.3.6, followed immediately by initiation of the auxiliary propane burners.

7.5.3.8 The flow rate of the auxiliary propane burners shall be adjusted to reproduce the time-temperature curve generated in 7.5.3.11.

7.5.3.9 The test shall continue for 30 minutes.

7.5.3.10 The main and auxiliary burners shall be extinguished at the end of 30 minutes, and the blank specimen shall be removed.

7.5.3.11 The heat release rate of propane in Btu/min (kW) shall be calculated as a function of time, based on the fuel flow rate recorded in 7.5.3.4.

7.5.3.12 The maximum average heat release rate, in Btu/ft²-min (kW/m²), shall be calculated for any 3-minute, 5-minute, and 10-minute interval during the test period and for the total 30-minute test duration using the integrated area under the heat release rate rate-time curve developed in 7.5.3.11 for the calibration test specimen.

7.5.3.13 The calculated heat release rate values shall not exceed the values specified in Table 7.5.3.13.

7.5.3.14 If the calculated maximum heat release rate values exceed the values in Table 7.5.3.13, the following procedure shall be performed:

- (1) The test equipment shall be checked for leaks, malfunctions, or other problems.
- (2) Where a problem is found, the problem shall be corrected, and a new calibration test in accordance with 7.5.1 through 7.5.3.13 shall be performed.

Table 7.5.3.13 Maximum Average Rate of Heat Release Rate for Various Time Intervals (Furnace Verification and Calibration)

| Time Interval (min) | Maximum Heat Release Rate | |
|---------------------|---------------------------|-------------------|
| | Btu/ft ² -min | kW/m ² |
| 3 | 410 | 77.6 |
| 5 | 390 | 73.8 |
| 10 | 360 | 68.1 |
| Test average | 285 | 54.0 |

Chapter 8 Conduct of Tests

8.1 Calibration Using Calibration Test Specimen. Prior to testing specimens, the test furnace shall have been successfully calibrated within the last 90 days using the calibration test specimen in accordance with Section 7.5.

8.2 Verification Using Blank Specimen. A successful verification of operation shall have been conducted within the previous 5 days using the blank specimen in accordance with Section 7.4.

8.3 Testing. The testing procedure shall be performed as described in 8.3.1 through 8.3.5.

8.3.1 The test specimen constructed in accordance with Section 6.3 and conditioned in accordance with Section 6.4 shall be installed on the test furnace.

8.3.2 The test procedure for the test specimen shall be in accordance with the procedures described in Section 7.5 except that the test specimen shall replace the calibration test specimen.

8.3.3* The application of an insulating cement material meeting 7.5.2.3 to the top of the test specimen shall be permitted to prevent flaming or visible smoke generation during the fire exposure test of the test specimen.

8.3.4 The maximum average heat release rate shall be calculated for any 3-minute, 5-minute, and 10-minute interval during the test period and for the total 30-minute test duration using the integrated area under the heat release rate-time curve developed in 7.5.3.13 for the test specimen.

8.3.5 The values shall be reported as Btu/ft²·min (kW/m²).

8.4 Acceptance Criteria.

8.4.1 The calculated maximum average rate of heat release for the test specimen for each time interval as calculated in 8.3.4 shall not exceed the values for the same time interval in Table 8.4.1.

8.4.2 During the fire test, there shall be no dropping of flaming particles into the furnace or uncontrolled flaming on the exterior surface of the test specimen.

Table 8.4.1 Maximum Average Rate of Heat Release Rate for Various Time Intervals

| Time Interval (min) | Maximum Heat Release Rate | |
|---------------------|---------------------------|-------------------|
| | Btu/ft ² ·min | kW/m ² |
| 3 | 410 | 77.6 |
| 5 | 390 | 73.8 |
| 10 | 360 | 68.1 |
| 30 | 285 | 54.0 |

Chapter 9 Report

9.1 Data and Information. The report shall include the data and information described in Sections 9.2 through 9.10.

9.2 Calibration Information. A description of the test results from the calibration test specimen shall be reported and shall include the following:

- (1) Weight of the wood fiberboard
- (2) Conditioning of the test specimen prior to testing
- (3) Date that the calibration was conducted
- (4) Auxiliary burner fuel flow rate, plotted as heat release rate as a function of time
- (5) Maximum heat release rate calculated at 3-minute, 5-minute, 10-minute, and 30-minute intervals

9.3 Test Specimen Materials. The name, thickness, density, size of all components (steel deck, insulation, cover boards, base, ply, top sheets, etc.) used to construct the test specimen, and a description of the construction details, including a diagram, shall be reported.

9.4 Main Burner Fuel Flow. The heptane fuel flow rate to the main burners for the duration of both the 30-minute fire exposure test and the evaluation test, plotted as heat release rate versus time, shall be reported.

9.5 Flue Gas Temperatures. The average flue gas temperatures, representing the time-temperature curve for the test specimen, measured by the 12 thermocouples located in the flue exhaust, for the duration of both the fire exposure test and the evaluation test shall be reported.

9.6 Auxiliary Burner Fuel Flow. The propane fuel flow rate to the auxiliary burner for the duration of the 30-minute evaluation test, plotted as heat release rate versus time, shall be reported.

9.7 Heat Release Rate. Calculated heat release rates of the test specimen, as determined by the auxiliary burner fuel flow rate at 3 minutes, 5 minutes, 10 minutes, and 30 minutes shall be reported.

9.8 Visual Observations. Observable damage to the exposed and unexposed sides of the test specimen after the test shall be documented using text, pictures, and drawings.

9.9 Internal Component Description. Post-test examination of the internal components of the test specimen shall be described.

9.10 Discussion of Performance. A complete discussion of specimen performance shall be provided, including a determination of the test specimen's performance based on the acceptance criteria in Section 8.4.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 In August 1953, the 35-acre General Motors Hydro-Matic factory in Livonia, MI, was destroyed by fire. Unprotected steel construction and the thin steel deck, which permitted the asphalt built-up roof covering to melt, drip through joints, and thereby contribute to fire spread within the building, were

factors cited as responsible for the extent of the loss. The fire resulted in the largest industrial fire loss in the United States to that date.

A 20 ft × 100 ft (6.1 m × 30.5 m) test structure was constructed to facilitate the analysis of the potential for contribution of roof-covering materials to fire spread within a building. Subsequent analysis consisted of a series of five large-scale fire tests utilizing different roof deck constructions, one of which represented the roof deck construction used in the General Motors factory. Based on those large-scale fire tests, a roof deck construction evaluated for the purpose of establishing limits for underdeck fire spread consisted of a built-up steel roof deck system.

Based on this full-scale testing, Factory Mutual (FM) developed the fire test procedure described in Appendix B of FM 4450, *Class 1 Insulated Steel Deck Roofs*, and incorporated only the wood fiberboard sample (on a steel deck with a steel cover) and not the roof-covering materials. The roof-covering materials were not included because research at FM determined that they did not contribute significantly to the heat release. In a 1959 NFPA article, "The FM Construction Materials Calorimeter," Thompson and Cousins reported on the development of the roof calorimeter test apparatus. The heat release contribution from this roof deck assembly was used to establish the 3-minute, 5-minute, 10-minute, and 30-minute average heat release limits. The wood fiberboard material used in the original test series is no longer available, but a substitute material has been identified. The wood fiberboard currently used in the test specimen provides the same heat release rate limits that are prescribed in Section 8.4.

A.1.1.1 This test was originally developed as a part of FM 4450, *Class 1 Insulated Steel Deck Roofs*.

A.1.1.3 Additional information on substitution method calorimetry is provided in Chapter 27 of the *SFPE Handbook of Fire Protection Engineering*.

A.1.2.1 This test method is based on the Fire Hazard Test Procedure in Appendix B of FM 4450, *Class 1 Insulated Steel Deck Roofs*.

A.1.2.3.1 The auxiliary fuel is intended to evaluate the heat release of the specimen compared with assemblies that performed acceptably based on full-scale testing following the fire at the GM factory in Livonia, MI (see A.1.1). The auxiliary fuel added equals the heat release produced by the test specimen because all other test conditions are maintained constant.

A.3.3.1 Blank Test Specimen. The blank test specimen is a reinforced refractory concrete panel that can also be used as a furnace cover.


A.4.1.1 Complete sets of construction details are available from FM Approvals, P.O. Box 9102, Norwood, MA 02062.

A.4.1.2 Figure A.4.1.2(a) is a photograph of the test furnace, and Figure A.4.1.2(b) is a sketch of the test furnace.

A.4.1.11 The following information is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees: Bete P54 nozzles (manufactured by Bete Fog Nozzle, Inc., Greenfield, MA) or equivalent spray nozzles are considered to be satisfactory.



FIGURE A.4.1.2(a) Photograph of the Test Furnace.

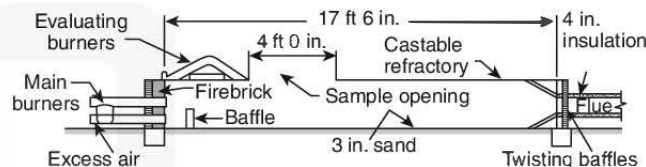

Note: For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m.

FIGURE A.4.1.2(b) Sketch of the Test Furnace.

A.4.1.14 The following information is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees: B&W K-20 or equivalent insulation is considered to be satisfactory.

A.8.3.3 The following information is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees: Insulating cement, available from ANH Refractories Company, Moon Township, PA, or its equivalent is considered to be satisfactory.

Annex B Informational References

B.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this code and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

B.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

Thompson, N. J., and E. W. Cousins, "The FM Construction Materials Calorimeter," *Quarterly of the National Fire Protection Association International*, Vol 52, No. 3, January 1959.

B.1.2 Other Publications.

B.1.2.1 FM Publications. FM Global, 270 Central Avenue,
P.O. Box 7500, Johnston, RI 02919-4923.

FM 4450, *Class 1 Insulated Steel Deck Roofs*, 1989.

B.1.2.2 SFPE Publications. Society of Fire Protection Engineers, 9711 Washingtonian Blvd., Suite 380, Gaithersburg, MD 20878.

SFPE Handbook of Fire Protection Engineering, 5th edition, 2016.

B.2 Informational References. (Reserved)

B.3 References for Extracts in Informational Sections. (Reserved)



Index

Copyright © 2022 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

- | | |
|---|---|
| <p>-A-</p> <p>Administration, Chap. 1</p> <p> Application, 1.3</p> <p> Purpose, 1.2</p> <p> Evaluation Test, 1.2.3</p> <p> Fire Exposure Test, 1.2.2</p> <p> Test Method, 1.2.1, A.1.2.1</p> <p> Scope, 1.1, A.1.1</p> <p>-B-</p> <p>Blank Test Specimen</p> <p> Definition, 3.3.1, A.3.3.1</p> <p>-C-</p> <p>Calibration Specimen</p> <p> Definition, 3.3.2</p> <p>Conduct of Tests, Chap. 8</p> <p> Acceptance Criteria, 8.4</p> <p> Calibration Using Calibration Test Specimen, 8.1</p> <p> Testing, 8.3</p> <p> Verification Using Blank Specimen, 8.2</p> <p>-D-</p> <p>Definitions, Chap. 3</p> <p>-E-</p> <p>Explanatory Material, Annex A</p> <p>-F-</p> <p>Furnace Verification and Calibration, Chap. 7</p> <p> Blank Specimen Test Procedure, 7.4</p> <p> Calibration Test Procedure, 7.5</p> <p> Evaluation Test Procedure, 7.5.3</p> <p> Fire Exposure Test Procedure, 7.5.2</p> <p> Verification Using Blank Specimen, 7.5.1</p> <p> Calibration Using Calibration Specimen, 7.2</p> <p> Preheating, 7.3</p> <p> Verification of Operation Using Blank Test Specimen, 7.1</p> | <p>-I-</p> <p>Informational References, Annex B</p> <p>Instrumentation, Chap. 5</p> <p> Pressure Measurement, 5.2</p> <p> Thermocouples, 5.1</p> <p>-R-</p> <p>Referenced Publications, Chap. 2</p> <p>Report, Chap. 9</p> <p> Auxiliary Burner Fuel Flow, 9.6</p> <p> Calibration Information, 9.2</p> <p> Data and Information, 9.1</p> <p> Discussion of Performance, 9.10</p> <p> Flue Gas Temperatures, 9.5</p> <p> Heat Release Rate, 9.7</p> <p> Internal Component Description, 9.9</p> <p> Main Burner Fuel Flow, 9.4</p> <p> Test Specimen Materials, 9.3</p> <p> Visual Observations, 9.8</p> <p>-S-</p> <p>Shall</p> <p> Definition, 3.2.1</p> <p>Should</p> <p> Definition, 3.2.2</p> <p>Standard</p> <p> Definition, 3.2.3</p> <p>-T-</p> <p>Test Furnace, Chap. 4</p> <p> Burner Fuels and Supply Air, 4.2</p> <p> Furnace Construction, 4.1</p> <p>Test Specimens and Conditioning, Chap. 6</p> <p> Blank Test Specimen, 6.1</p> <p> Calibration Specimen, 6.2</p> <p> Conditioning, 6.4</p> <p> Test Specimen, 6.3</p> |
|---|---|

Sequence of Events for the Standards Development Process

Once the current edition is published, a Standard is opened for Public Input.

Step 1 – Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Technical Committee holds First Draft Meeting to revise Standard (23 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Technical Committee ballots on First Draft (12 weeks); Technical Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted on the document information page

Step 2 – Comment Stage

- Public Comments accepted on First Draft (10 weeks) following posting of First Draft Report
- If Standard does not receive Public Comments and the Technical Committee chooses not to hold a Second Draft meeting, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance (see Step 4) or
- Technical Committee holds Second Draft Meeting (21 weeks); Technical Committee(s) with Correlating Committee (7 weeks)
- Technical Committee ballots on Second Draft (11 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee Second Draft Meeting (9 weeks)
- Correlating Committee ballots on Second Draft (8 weeks)
- Second Draft Report posted on the document information page

Step 3 – NFPA Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks) following the posting of Second Draft Report
- NITMAMs are reviewed and valid motions are certified by the Motions Committee for presentation at the NFPA Technical Meeting
- NFPA membership meets each June at the NFPA Technical Meeting to act on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the NFPA Technical Meeting

Step 4 – Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Technical Meeting action must be filed within 20 days of the NFPA Technical Meeting
- Standards Council decides, based on all evidence, whether to issue the standard or to take other action

Notes:

1. Time periods are approximate; refer to published schedules for actual dates.
2. Annual revision cycle documents with certified amending motions take approximately 101 weeks to complete.
3. Fall revision cycle documents receiving certified amending motions take approximately 141 weeks to complete.

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment Through the Online Submission System

Following publication of the current edition of an NFPA standard, the development of the next edition begins and the standard is open for Public Input.

Submit a Public Input

NFPA accepts Public Input on documents through our online submission system at www.nfpa.org. To use the online submission system:








- Choose a document from the List of NFPA codes & standards or filter by Development Stage for “codes accepting public input.”
- Once you are on the document page, select the “Next Edition” tab.
- Choose the link “The next edition of this standard is now open for Public Input.” You will be asked to sign in or create a free online account with NFPA before using this system.
- Follow the online instructions to submit your Public Input (see www.nfpa.org/publicinput for detailed instructions).
- Once a Public Input is saved or submitted in the system, it can be located on the “My Profile” page by selecting the “My Public Inputs/Comments/NITMAMs” section.

Submit a Public Comment

Once the First Draft Report becomes available there is a Public Comment period. Any objections or further related changes to the content of the First Draft must be submitted at the Comment Stage. To submit a Public Comment follow the same steps as previously explained for the submission of Public Input.

Other Resources Available on the Document Information Pages

Header: View document title and scope, access to our codes and standards or NFCSS subscription, and sign up to receive email alerts.

| | |
|---|--|
|  Current & Prior Editions | Research current and previous edition information. |
|  Next Edition | Follow the committee's progress in the processing of a standard in its next revision cycle. |
|  Technical Committee | View current committee rosters or apply to a committee. |
|  Ask a Technical Question | For members, officials, and AHJs to submit standards questions to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA standards relevant to your work. |
|  News | Provides links to available articles and research and statistical reports related to our standards. |
|  Purchase Products & Training | Discover and purchase the latest products and training. |
|  Related Products | View related publications, training, and other resources available for purchase. |

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the *NFPA Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include *NFPA Bylaws*, *NFPA Technical Meeting Convention Rules*, *NFPA Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the *NFPA Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA headquarters; all these documents are also available on the NFPA website at “www.nfpa.org/regs.”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at Section 1.4.)

III. Step 1: First Draft Report. The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3.) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b).]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.4.) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the NFPA Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b).]

V. Step 3a: Action at NFPA Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion (NITMAM). (See *Regs* at 4.5.2.) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June NFPA Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an NFPA Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no NITMAM is received and certified in accordance with the *Technical Meeting Convention Rules*, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5.)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the NFPA or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (see *Regs* at Section 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an NFPA Technical Meeting within 75 days from the date of the recommendation from the NFPA Technical Meeting, unless this period is extended by the Council (see *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (see *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the NFPA. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in Section 1.7 of the *Regs*.

X. For More Information. The program for the NFPA Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. To view the First Draft Report and Second Draft Report as well as information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/docinfo) or contact NFPA Codes & Standards Administration at (617) 984-7246.



CODES AND STANDARDS GO DIGITAL. AND GO ANYWHERE.

**TRY NFPA LiNK® FREE FOR 14 DAYS
AND GET DIGITAL ACCESS TO
CODES AND STANDARDS.**

Discover NFPA LiNK. It's dynamic digital access to codes and standards, right at your fingertips. Search, share, and find solutions on the job, faster and more efficiently. Now you can get your first two weeks free with a hassle-free trial, at no cost and no credit card required. If NFPA LiNK is right for you, subscriptions start as low as \$9.99/month. Experience the power of NFPA LiNK for yourself.

Learn more and activate your risk-free trial for 14 days free at nfpa.org/LiNK